

Environmental Impact Assessment for Development of new Power House at G.Dh. Nadella



April 2016

Proponent: FENAKA Corporation Limited

Prepared by;

Mahfooz Abdull Wahhab

Mohamed Ibrahim Jaleel

Ali Shareef

Table of Contents

1.0 INTRODUCTION	11
1.1 Purpose of this EIA	11
1.2 Project background	11
1.3 Project Objectives	11
1.4 Proponent	11
1.4.1 Power generation services	11
1.4.2 Water and Waste water services	12
1.5 Consultants	13
2.0 STUDY AREA	14
2.1 Relevant development in the area	15
3.0 PROJECT DESCRIPTION	16
3.1 Proposed Works	16
3.1.1 Construction of new power house	16
3.1.2 Transfer of generators and panel boards	17
3.2 Powerhouse design	17
3.2.1 Generator set details	17
3.2.2 Sound Minimization	18
3.2.3 Emergency power mechanism	18
3.2.4 Measures to increase power efficiency	18
3.2.5 Safety components	18
3.2.6 Fuel Management	18
3.3 Project inputs and outputs	24
3.4 Detailed construction method	24
3.4.1 Workforce	24
3.4.2 Materials and machinery required for construction	24
3.4.3 Mobilization	25
3.4.5 Proposed timeline for project activities	25
4.0 EXISTING ENVIRONMENT	26

4.1 General Climate 26

4.2 Temperature 26

4.3 Rainfall 27

4.4 Insolation 28

4.5 Wind 29

4.6 Waves 30

4.7 Hazard Vulnerability 31

4.8 Water Quality 33

 4.8.1 Sampling method 33

 4.8.2 Sampling location 34

 4.8.3 Results 35

4.9 Vegetation 36

 4.9.1 Method 36

 4.9.2 Results 36

 4.9.1 Dhivehi names for the vegetation 38

4.10 Noise level 40

 4.10.1 Method 40

 4.10.2 Results 41

4.11 Air quality 42

 4.11.1 Method 42

 4.11.2 Results 43

5.0 LEGISLATIVE AND REGULATORY CONSIDERATIONS 46

 5.1 Law on general public services (4/96) 46

 5.2 Law on Environmental Protection and Preservation of the Maldives (4/93) 46

 5.3 1st addendum to Environmental Protection and Preservation of the Maldives (4/93) law no 12/2014 47

 5.4 Environmental Impact Assessment Regulation 2012 48

 5.5 Waste management regulation 49

 5.6 Regulation on provision of electricity to Male’ and islands 55

 5.7 Guideline for power system approval 60

6.0 POTENTIAL IMPACTS AND MITIGATION 61

6.1 Impact identification methodology 61

6.2 Limitations in impact prediction 62

6.3 Impacts during Construction 62

 6.3.1 Impacts on Air quality 63

 6.3.2 Impacts on water quality 63

 6.3.3 Impacts from Waste 64

 6.3.4 Impacts on terrestrial environment 64

6.4 Impacts summary 64

6.5 Impacts during operation 66

 6.5.1 Impacts on water quality 66

 6.5.2 Impacts on air quality 67

 6.5.3 Noise disturbance 67

 6.5.4 Socio-economic impacts 68

 6.5.5 Health 68

 6.5.6 Impacts from Waste 68

 6.5.7 Fire hazard risk and safety 69

6.6 Impacts summary 69

7.0 ALTERNATIVES 72

 7.1 No project scenario 72

 7.2 Alternative locations for powerhouse 72

8.0 MONITORING 74

 8.1 Monitoring schedule 75

9.0 STAKEHOLDER CONSULTATIONS 76

 9.1 Public Consultation 76

 9.2 Meeting with the island council 77

 9.3 Consultations with working staff on site 79

10.0 CONCLUSION 80

11.0 REFEEERENCES 81

List of Figures

Figure 1: location of Nadella, G.Dh Atoll14

Figure 2: study area15

Figure 3: proposed powerhouse location.....17

Figure 4: site plan of the project20

Figure 5: sectional elevation of powerhouse21

Figure 6: floor plan of powerhouse22

Figure 7: front and side elevation of powerhous23

Figure 8: proposed timeline for project activities.....25

Figure 9: monthly maximum and minimum temperatures(⁰C) for Maldives throughout the year.
 Data since 2000, adopted from the National Meterological Centre.27

Figure 10: rainfall (mm) data since 2000, adopted from the National Meterological Centre28

Figure 11: average daily insolation (hours) for different areas29

Figure 12: wind vectors from 2003 to 2008.30

Figure 13: Ten year mean monthly wave height and direction for the central Maldives. Source:
 Young (1999).....31

Figure 14: flooding at the proposed powerhouse location32

Figure 15: aerial pictures of Nadella over the past years33

Figure 16: water sample locations35

Figure 17: high density Cyperus polystachyos growing around the wetland.....37

Figure 18: types of plants in plot given for powerhouse development39

Figure 19: noise level measurement locations.....41

Figure 20: air quality measurement locations.....43

Figure 21: impact zone during construction. Orange; is primary impact zone and yellow; is
 secondary impact zone.....62

Figure 22: impact zone during operations. Orange; primary impact zone and green; secondary
 impact zone.....66

Figure 23: alternative location for powerhouse. In yellow is the reclaimed wetland area, maroon
 is the alternative location option 1, orange is alternative location option 2, red is the existing
 wetland, blue is the given plot for powerhouse, green is the waste disposal area, and purple is the
 graveyard.73

Figure 24: crack lines in house77

List of Tables

Table 1: generator set details in G.Dh Nadella.....18
 Table 2:estimated quantities of project inputs and outputs24
 Table 3: geocordinates of water sample location34
 Table 4: water sample results35
 Table 5: geocordinates for proposed powerhouse location37
 Table 6: Dhivehi and scientific names for plants38
 Table 7: geocordinates of noise level measurement locations40
 Table 8: results of noise level measurements41
 Table 9: geocordinates of air quality measurement locations42
 Table 10: air quality results43
 Table 11: population details of Nadella.....44
 Table 12: impact characteristics, where 5 is of highest significance.....61
 Table 13: summary of impacts during construction65
 Table 14: summary of impacts during operation.....70
 Table 15: environmental monitoring plan74
 Table 16: monitoring schedule75
 Table 17: details of individuals consulted76
 Table 18: attendees of council meeting78
 Table 19: details of staffs that were consulted.79

Declaration of the proponent

As the representative of the proponent of the proposed project I assure that I have read the report thoroughly and that to the best of my knowledge all information provided here is accurate and complete. In addition, I confirm our commitment to making sure that the contractor implements all mitigation measures proposed in the present report and adhere to the monitoring schedule given.

Name: Ahmed Najaah

Date: 25th April 2016

Signature:



DECLARATION OF CONSULTANTS

We hereby confirm that the information in this report is accurate to the fullest of our understanding.



Ali Shareef (EIA 19/11)



Mahfooz Abdul Wahhab (Registration no: EIA TA03/15)

1.0 INTRODUCTION

1.1 Purpose of this EIA

The aim of this EIA is to critically analyze the environmental and socio-economic impacts which may arise due to the relocation of power house in G.Dh. Nadella. After analyzing the impacts it would be then possible to suggest proper mitigation measures to prevent or reduce any negative impacts and to enhance any positive impacts.

1.2 Project background

In Nadella, the currently operational powerhouse is in the middle of the residential area. The smoke and noise from the powerhouse is disturbing the neighboring houses. Furthermore the existing powerhouse is not in accordance with current standards. The current project aims to minimize the disturbance to residents by building a new powerhouse away from the residential area.

1.3 Project Objectives

The objective of the project is to build a power house to provide power in a sustainable manner to the people of Nadella with minimum disturbance to residents.

1.4 Proponent

The proponent, Fenaka Corporation Limited was established on 18th June 2012 by a presidential decree under the companies Act of 10/96, as a limited liability company. The company is registered on 1st of August 2012 and it is 100% Government owned utility company with a mandate to provide island communities with electricity, water and sewerage. Today, FENAKA is a multi-disciplinary engineering organization, dealing contracts involved in civil, mechanical, electrical, water and waste water engineering.

1.4.1 Power generation services

Out of a total of 196 inhabited islands in the country, FENAKA Corporation provides electricity services to 152 islands. 24 / 7 sustainable electricity provision was not achieved to outer islands until recently FENAKA corporation started providing the services to the islands. In its short history the company has carried out numerous projects for the betterment of the service provision, one such example is the 77 Genset project which aided in the sustainable service provision. Furthermore, as electricity services were provided by the island communities themselves in the past, the location, infrastructure and operations were not ideal. This causes negative impacts and disturbance to the communities and the environment. Therefore, every year the company carries out a number of projects in power house relocation, refurbishment and generated set upgrading throughout the country.

Electricity is mainly generated through diesel, however the Company is now slowly shifting towards renewable energy as a form of power generation. The company is also an important implementing partner in the mega projects of the Governments renewable energy. Some of these projects include;

- Preparation of outer islands for Sustainable energy development (POISED), funded by Asian Development Bank
- Accelerating Sustainable Private Investments in Renewable Energy (ASPIRE), funded by the World Bank

1.4.2 Water and Waste water services

At FENAKA Corporation, safe water is provided to the public after desalinating sea water into potable drinking water through the process of reverse osmosis. Water produced and distributed by the Company adheres to the standards set by Environment Protection Agency (EPA) in the Maldives. Currently the company operates fully fledged system with complete RO plants, distribution networks and pipe distribution to households in 4 islands, which includes; GDh. Thinadhoo, GDh. Gahdhoo, Ha.Ihavandhoo and Ha.Thuraakunu. Out of the 3 islands, two of them are operated on the principles of Integrated Water Resource Management (IWRM) where conjunctive use of water is practiced, whereby 25% of the total demand is catered by rainwater by catchment from public roof tops. This is in line with the countries global commitments of the Sustainable Development Goals where the adaptation of IWRM principles is a specified goal. Other than the fully fledged systems, the company also have standalone RO plants, some with community tap bay systems where services are mainly to the fishing vessels and any other need of the community.

Other than service provision, the company also implements one of the largest water projects of the nation, which is the provision of water supply services to the Allied islands of Addu City. The project is nearing completion and is expected to be completed within this year.

FENAKA operates the sewerage system of around 28 islands by means of a gravity collection system and effluent is discharged to the open ocean by means of pump stations and sea outfalls. Furthermore, the company has recently successfully completed the design and construction of sewer systems in Th. Buruni and Th. Madifushi and the sewer project for L. Maamendhoo is ongoing. Moreover, the construction of sewer services of Hithadhoo central area is also carried out by Fenaka Corporation.

1.5 Consultants

This EIA report has been compiled by Mahfooz Abdull Wahhab and Mohamed Ibrahim Jaleel who are registered temporary EIA Consultants. The report was reviewed and edited by Ali Shareef, who is a registered EIA consultant with over 19 years of experience and has been involved in numerous projects in the Maldives such as resort development project, sewerage system, RO plants, reclamation, shore protection and harbour projects.

2.0 STUDY AREA

Nadella is located in the western rim of Huvadhoo Atoll, hence the island is exposed to strong swell waves on the South-West monsoon.



Figure 1: location of Nadella, G.Dh Atoll

Nadella lies on the longest continues reef flat on Huvadhoo. The reef flat system measures about 34 Km in length. The reef flat system has 4 other inhabited island besides Nadella (Madaveli, Hoandedhoo, Rathafandhoo and Fiyolari) and several uninhabited islands.

The study area comprises of the entire Nadella Island. Figure below shows the study area boundaries.

There is an environmentally sensitive area on Nadella; a small wetland towards the Northern tip of Nadella. The wetland is about 126 meters in length and 60 meters at the widest point.



Figure 2: study area

2.1 Relevant development in the area

The reclaimed area to the East of the proposed powerhouse location is an area from which housing plots will be given.

3.0 PROJECT DESCRIPTION

3.1 Proposed Works

3.1.1 Construction of new power house

The current project is looking at the development of a new power house in the proposed location shown on figure below. The project also involves the transfer of the existing temporary generators to the new powerhouse.

The construction of new powerhouse will involve;

Site clearance

Excavation works

Backfilling

Waterproofing

Concreting works of foundation column and roof beams

Masonry and plastering

Roofing

Building of day tanks and fuel storage tanks

Ceiling

Doors and windows installation

Hydraulics and drainage works

Electrical installations

Painting



Figure 3: proposed powerhouse location.

3.1.2 Transfer of generators and panel boards

The existing generators will be lifted from its existing place using a crane and then transferred into the power house. New panel boards will be installed at the new power house. The output from the generators will be connected to the existing distribution grid.

3.2 Powerhouse design


Figures 4 -7 shows the powerhouse elevations. The powerhouse is designed in accordance with MEA and EPA standards.

3.2.1 Generator set details

Existing generators total capacity is 330 KW, the details are as follows;

- 700 liters day tanks with flow-meters and level detection. Tank installed with 150mm concrete base.
- Fuel pipe line : GI Pipelines conforming to international standards. Pipes will be laid 300mm above ground level. Leak detection and echo-sounding in main tanks and lines will be equipped with flow-meter
- Fuel to be transferred directly from transport vessel (from harbor) to fuel tank at power house through fuel transfer hose, Or by approved vehicles for fuel transfer. Distance is 170ft
- Lubricant oil consumption : average 74.25 Liters per month

SITE PLAN
SCALE - 1:200

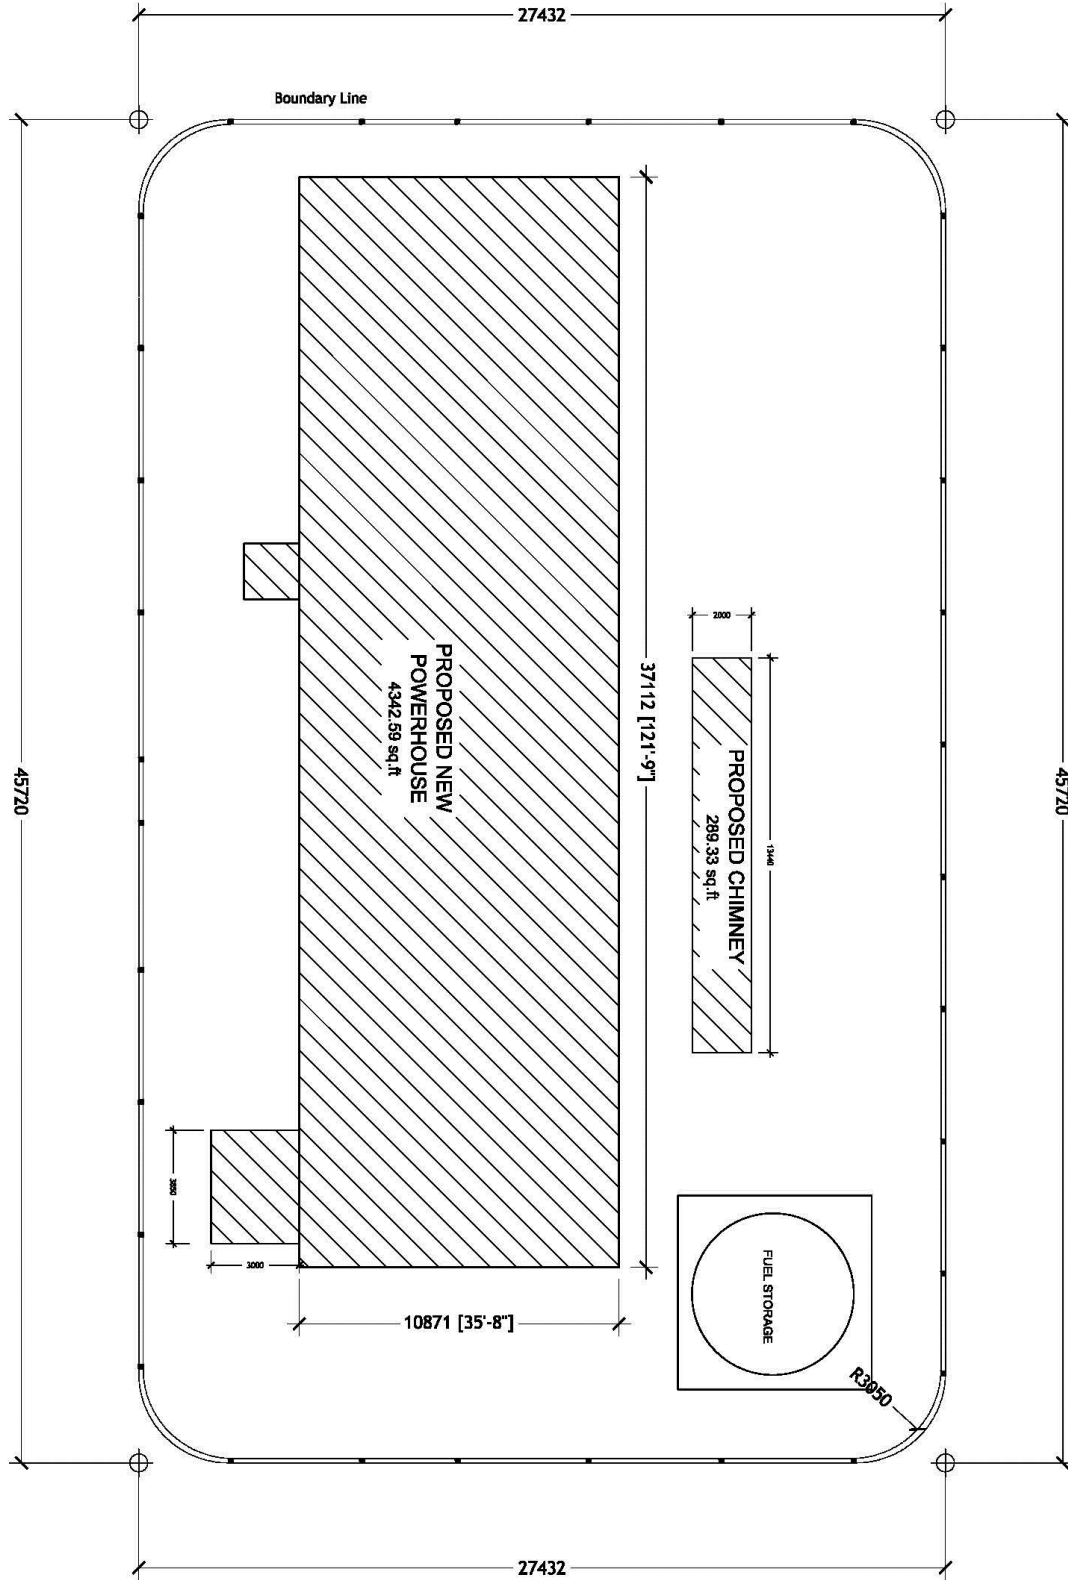

TOTAL LOT AREA: 13,500.00 SQFT
TOTAL BUILT-UP AREA: 4,631.92 SQFT


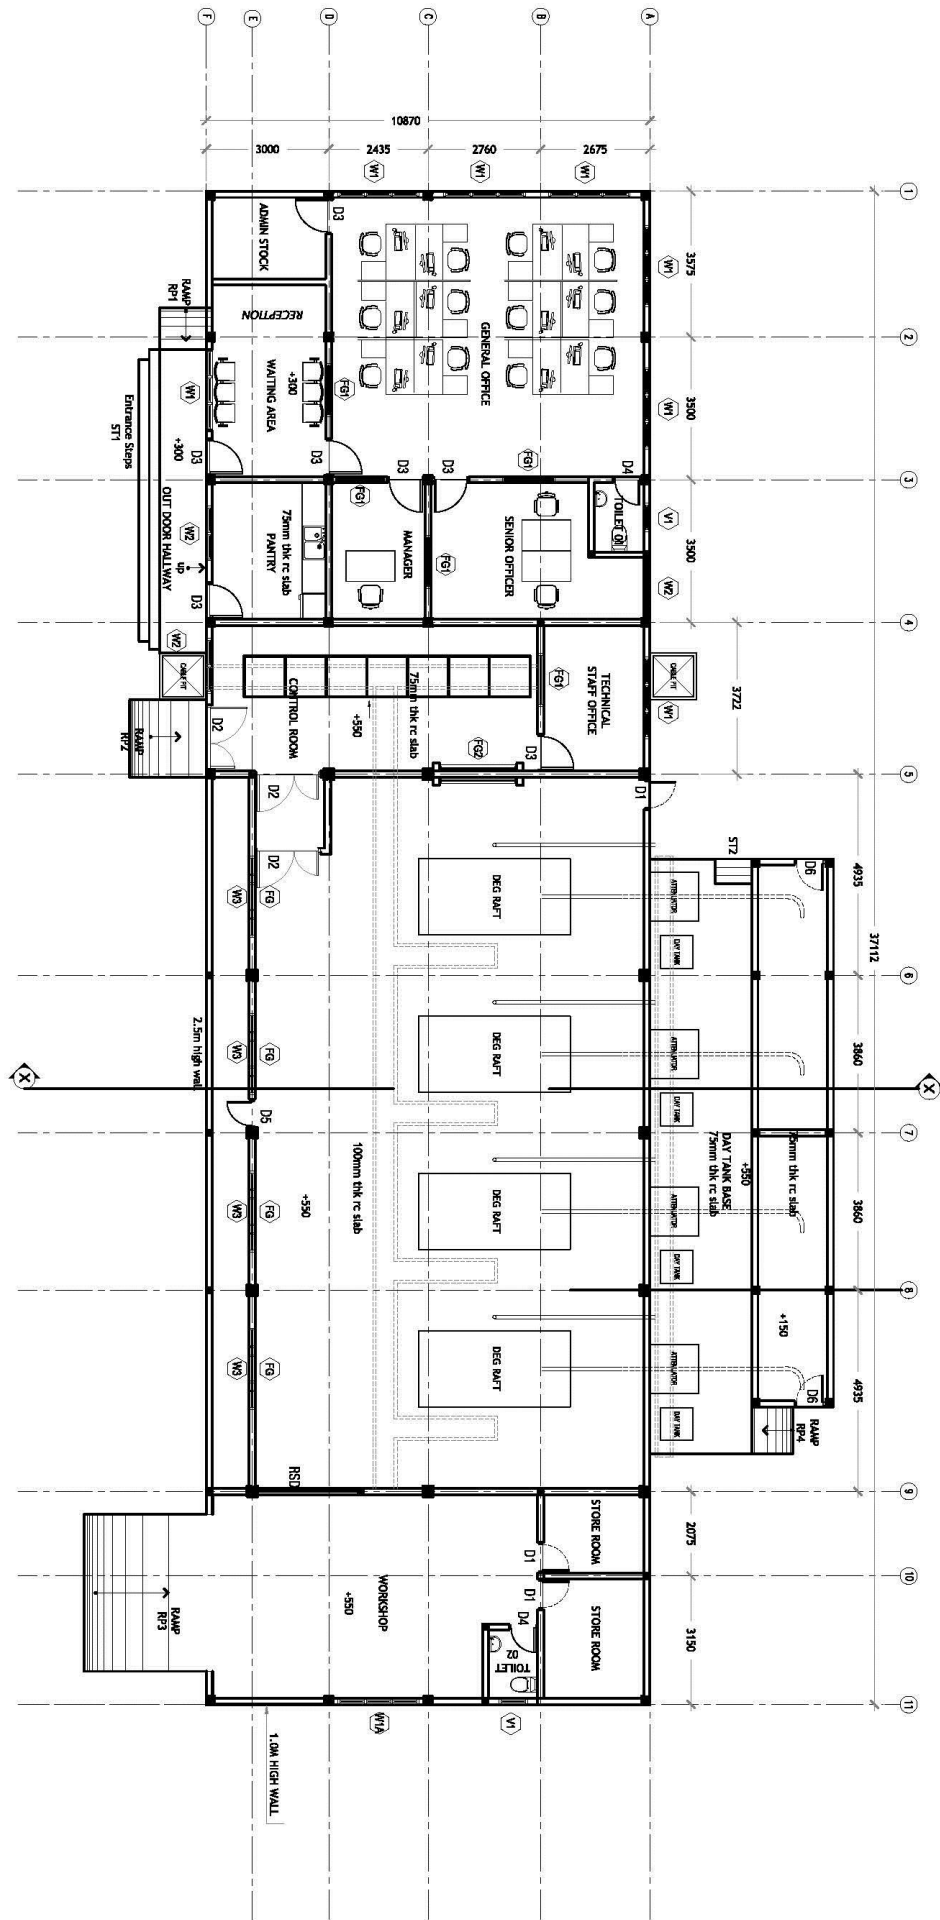
 Smart Port, Port Complex, Male' Atoll, Maldives Tel: +960 330255 Fax: +960 3327555 Email: info@fenaka.com.mv Website: www.fenaka.com.mv	
PROJECT:	POWER HOUSE - TYPE C
LOCATION:	
APPROVED BY:	MUHAMMAD NIHAL MANAGING DIRECTOR
CHECKED BY:	ABDULLA NASHITH DIRECTOR
ARCHITECTURAL DESIGN:	ASVATHI, M. SHARBEEF
ENGINEER:	ASVATHI
DRAWN BY:	ASVATHI, M. SHARBEEF
SERVICES ENG.:	ASVATHI, M. SHARBEEF
DWG TITLE:	AS GIVEN
SCALE:	AS GIVEN
DIMENSION:	mm
DATE:	DEC 2015
REVISION:	
CONTRACTORS MUST CHECK ALL DIMENSIONS ON SITE BEFORE STARTING ANY WORK OR SHOP DRAWINGS. FIGURED DIMENSIONS TO TAKE PRECEDENCE OVER SCALE READINGS. DO NOT SCALE DRAWINGS, IN CASE DOUBT, PLEASE ASK.	
DWG NO.:	A-01
PROJECT NO.:	

Figure 4: site plan of the project

FLOOR PLAN
SCALE 1:100



<p>ދިވެހިސަރުކާރުގެ ގެޒެޓް ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ 20307 ވަނަ އަދަދު، 2015 ވަނަ އަހަރު ދިވެހިސަރުކާރުގެ ގެޒެޓް</p>	
PROJECT:	POWERHOUSE - TYPE C
LOCATION:	
APPROVED BY:	MOHAMMED NAWAZ MANAGING DIRECTOR
CHECKED BY:	ABDULLA NASHIH DIRECTOR
ARCHITECTURAL DESIGN:	ABDULLA NASHIH
ENGINEER:	ASITHA
DRAWN BY:	ASITHA, ASHVEER
SERVICES ENG.:	ASITHA, ASHVEER
DWG TITLE:	AS GIVEN
SCALE:	AS GIVEN
DIMENSION:	MM
DATE:	DEC 2015
REVISION:	
<p>CONTRACTOR MUST CHECK ALL DIMENSIONS AND FINISHES BEFORE STARTING WORK. ANY WORK DONE WITHOUT THESE DIMENSIONS TO TAKE PRECEDENCE OVER SCALE/REVISED DIMENSIONS. ANY WORK DONE WITHOUT THESE DIMENSIONS TO TAKE PRECEDENCE OVER SCALE/REVISED DIMENSIONS. ANY WORK DONE WITHOUT THESE DIMENSIONS TO TAKE PRECEDENCE OVER SCALE/REVISED DIMENSIONS.</p>	
DWG NO.:	A-42
PROJECT NO.:	

Figure 6: floor plan of powerhouse

3.3 Project inputs and outputs

Table 2: estimated quantities of project inputs and outputs

Inputs	Outputs
Generators - Fuel (475-500 liters per day)	Electricity (1500-1600 W per day) Greenhouse gases
Workforce (Supervisors, Managers, Construction workers etc.) - 2 managers - 3 supervisors - 3 technician - 12 construction workers	Waste - 1.2 m ³ flow per day
Machineries and equipment's - 1 crane Fuel - 80 liters per day	Greenhouse gases, effluents

3.4 Detailed construction method

3.4.1 Workforce

The workforce required for the construction shall be stationed within the island in existing houses. G.Dh. Nadella has all the utility services therefore there is no requirement to do additional work to provide the services to the workforce.

3.4.2 Materials and machinery required for construction

The material required for construction which is not available locally, shall be imported and shipped from Male' to the site.

The equipment's required for the project are a crane and general construction tools. Some of these are available at the company and others would be sourced from available shops.

3.4.3 Mobilization

The cranes required for the project will be carried to Nadella via a barge. Other materials and workforce will be transported in a ferry.

3.4.4 Establishment of temporary project facilities

No temporary project facilities will be required to build as the required housing for the workforce will be provided from the residential houses in Naella. Waste generated will be temporarily stored at site and transferred to Thilafushi in a monthly basis.

3.4.5 Proposed timeline for project activities

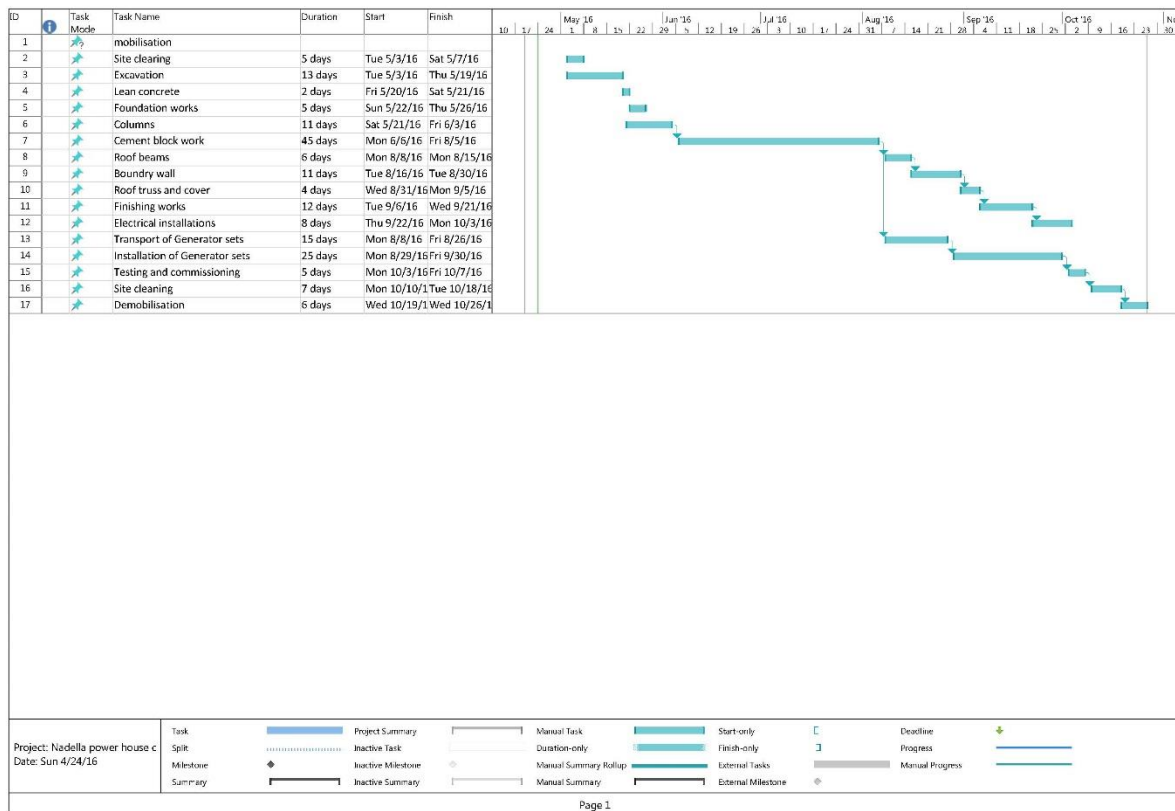


Figure 8: proposed timeline for project activities

4.0 EXISTING ENVIRONMENT

4.1 General Climate

As most of the islands of Maldives is located within and in very close proximity to the equator, all islands experience monsoonal climate. Towards the North the effect of Seasons are more apparent and hence experience infrequent torrential rain, while towards the South the effect of seasons are negligible and experience frequent rain.

Maldives experiences two distinctive monsoons; the North-East Monsoon or dry monsoon which last from January to March and the South-West monsoon or wet monsoon which lasts from May to November. In both seasons the temperature varies slightly despite the huge difference in rainfall.

4.2 Temperature

As the Maldives consists of small islands surrounded by sea even hot days are tempered by cooling sea breezes and mild evening temperatures. Therefore thought the year there is little change in temperature. However the daily temperatures fluctuates between 31 °C in daytime and 23 °C at night. However there were rare temperature anomalies recorded; on 19th May 1991 the highest temperature ever recorded in Maldives was recorded at Kahdhoo Meteorological office - 36.8 °C and on 11th April 1978 the lowest temperature was recorded in National Meteorological Center- 17.2 °C.

Looking closely at the monthly maximum and minimum temperatures from four different meteorological centers, it becomes clear that there is a very small fluctuation in the maximum and minimum temperatures throughout the year. However as expected there is a considerably huge variation in the maximum and minimum temperature for Hanimadhoo. From February to May, the minimum temperature for Hanimaadhoo rose from 24.5 °C to 26.5 °C.

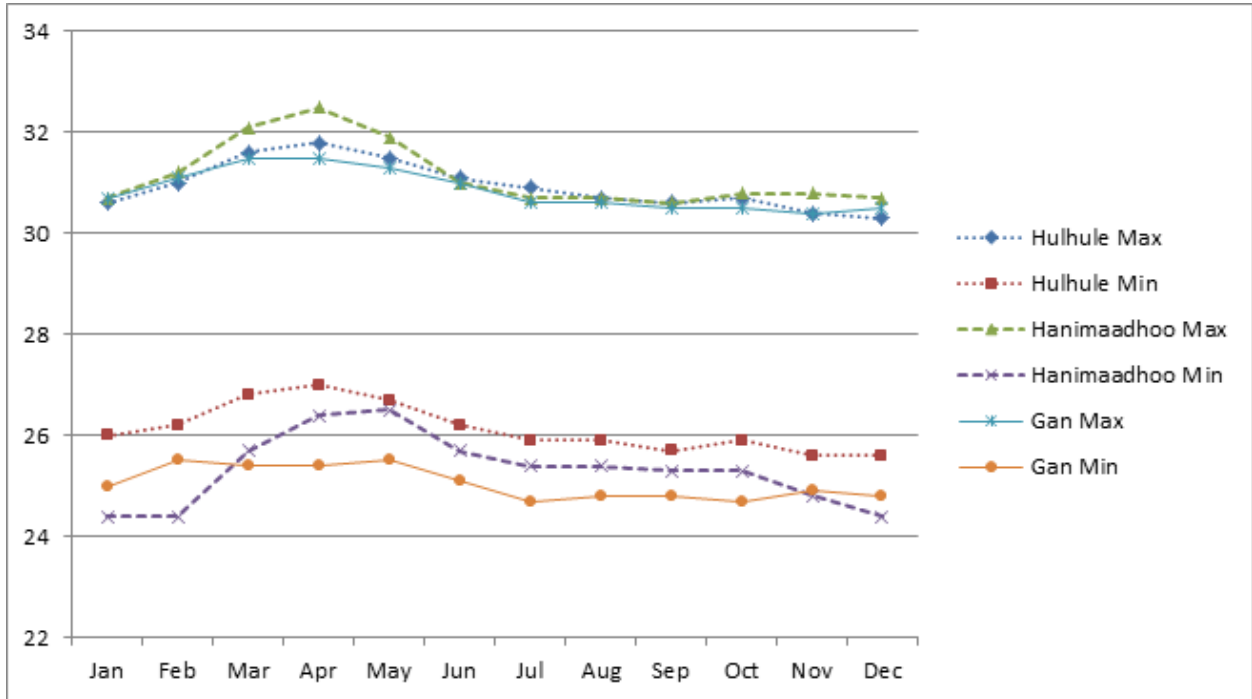


Figure 9: monthly maximum and minimum temperatures(°C) for Maldives throughout the year. Data since 2000, adopted from the National Meteorological Centre.

4.3 Rainfall

During the South-West monsoon, from mid-May to December heavy rainfall is experienced to all atolls. The highest rainfall ever recorded during a 24 hour period was on 9th July 2002 at Kaadedhdhoo Meteorological office, which was 219.8 mm of rainfall.

Looking at rainfall data since 2000, heavy rainfall is experienced (between 200mm and 250mm of rainfall) from May to December. Lowest rainfall is between February and March, where rainfall is between 25mm and 80mm.

There is a considerable difference in the rainfall pattern between the North and the rest of Maldives during May to July and October to December. For North rainfall is higher during May to July which is at 250mm while for other areas 170mm of rainfall, during October to December rainfall for North declines from 225mm to 100mm while rainfall for other areas remains between 210mm and 240mm.

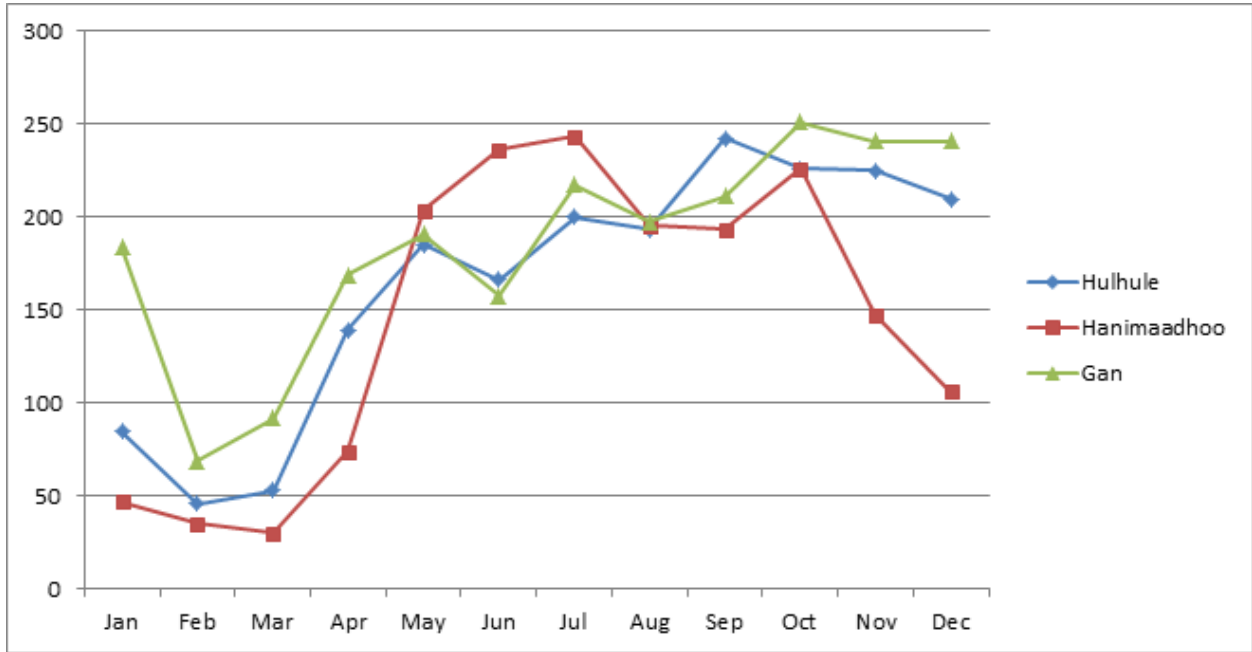


Figure 10: rainfall (mm) data since 2000, adopted from the National Meterological Centre

4.4 Insolation

As the Maldives lie within the equator, it received plentiful of sunlight everyday throughout the year. Highest insolation is received between February and April with a peak of 12 hours of daylight. For North, insolation is lower than for the other areas between May and July; 7 hours of insolation for North while for other areas the lowest sunshine was 8.5 hours.

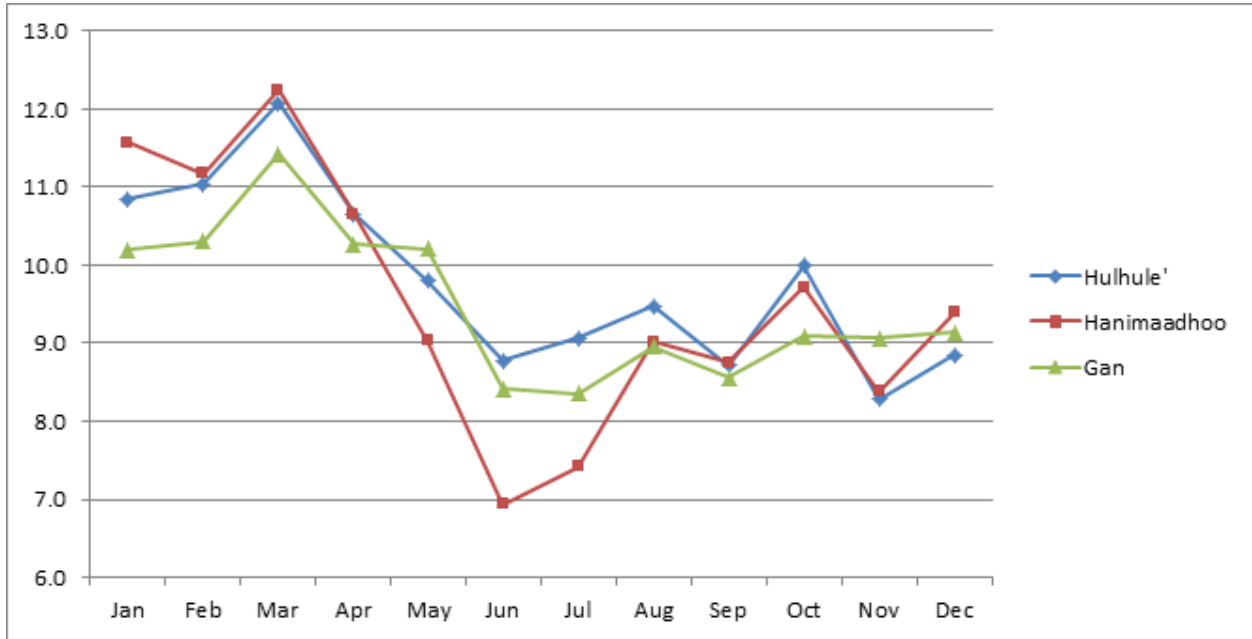


Figure 11: average daily insolation (hours) for different areas

4.5 Wind

The following figure shows wind pattern from year 2003 to 2008, adopted from EIA report for development of B. Voavah as a luxury tourist resort (2015). The blue vectors represent wind direction in the NE monsoon and green vectors represent wind direction in the SW monsoon. As can be seen from the vectors during the SW monsoon wind predominately blows from the SW and during NE from the NE.

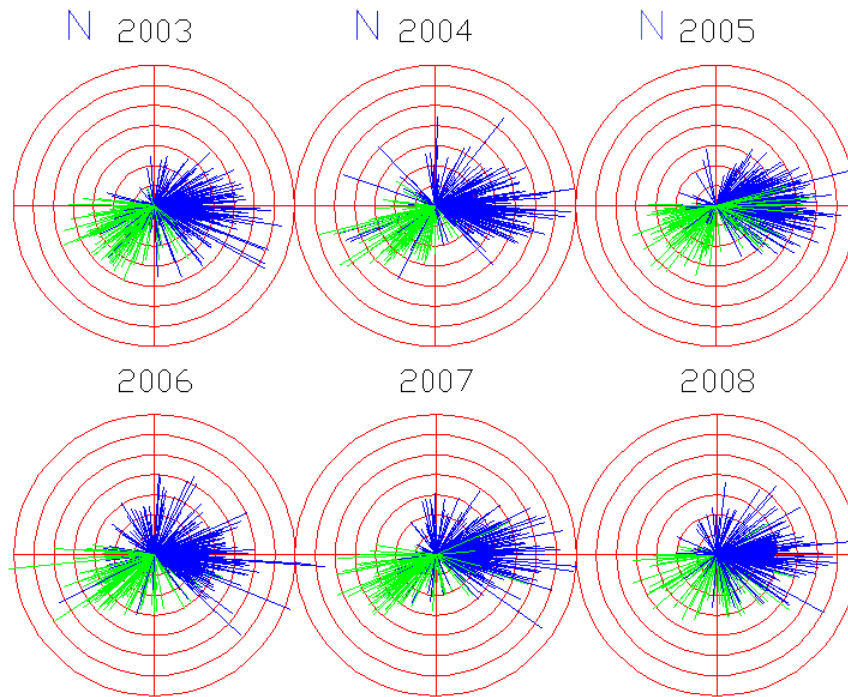


Figure 12: wind vectors from 2003 to 2008.

4.6 Waves

The following figure shows waves data gathered by Young (1999) for a ten year period for each world regional zone. This data was adopted from EIA report for development of B. Voavah as a luxury tourist resort (2015). In this research by Young Wave height was measured by satellite (Radar Altimeter), whereas a global wave model was used to precise wave directions. It indicates that dominant swell waves during the SW monsoon comes from SW and during NE monsoon from the NE. The peak wave height according to this model is in June with 1.8 meters. This corresponds with the roughest weather days for Maldives, which is roughly June and July.

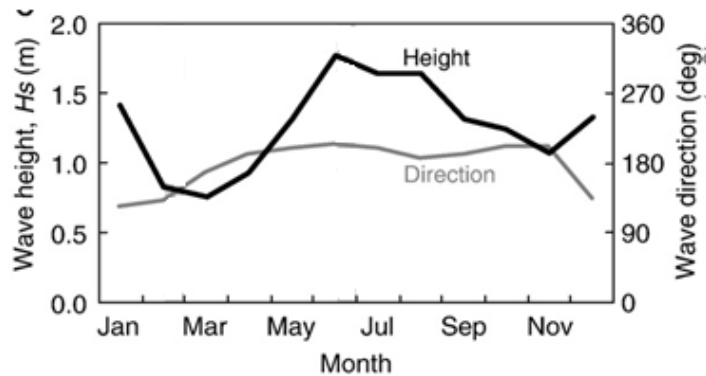


Figure 13: Ten year mean monthly wave height and direction for the central Maldives. Source: Young (1999).

4.7 Hazard Vulnerability

The proposed location for powerhouse is not vulnerable to storm surges. Figure 15 shows aerial pictures of Nadella over the past years. The pictures reveal that there is not much changes to the island.

However as the location was previously a wetland, during heavy rainfall this area floods.



Figure 14: flooding at the proposed powerhouse location

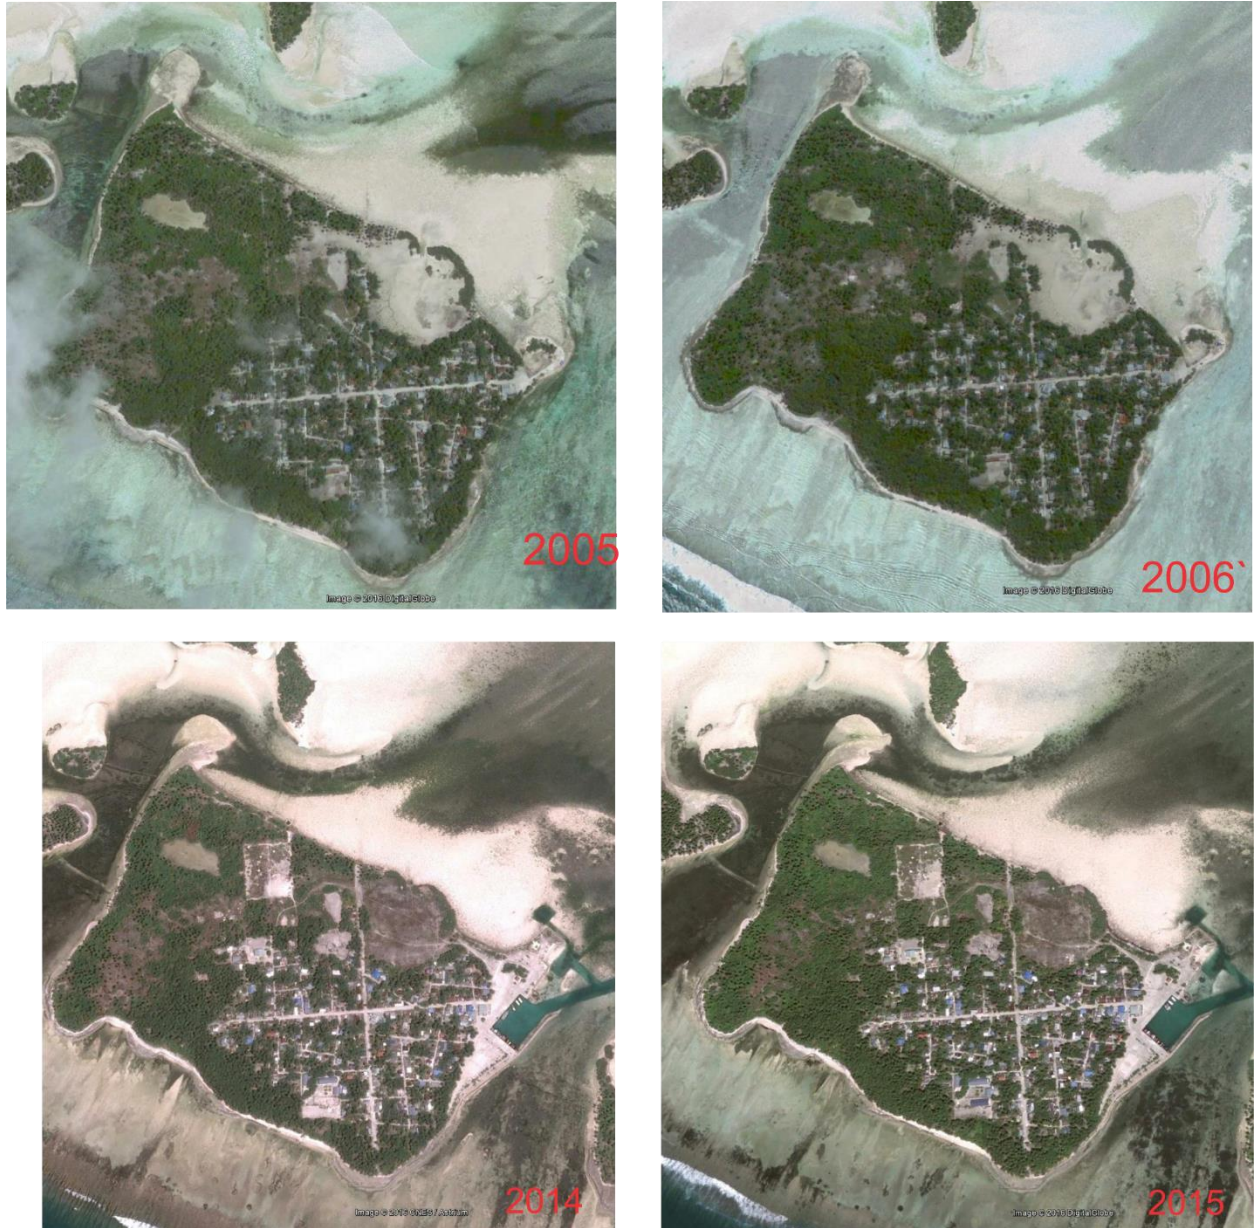


Figure 15: aerial pictures of Nadella over the past years

4.8 Water Quality

4.8.1 Sampling method

2 water sample was taken from an existing well from two houses; naatakuge and coral garden. 1 water sample was taken from the proposed powerhouse location by digging a well. Water from the

well was collected by dipping a bucket into the well. Water sampling bottle was rinsed 3 times from the well water.

Water sample was collected in a 1.5 mL plastic bottle on 04th April 2016. The bottle was chilled and transferred to Male’, which was later tested at MWSC laboratory.

4.8.2 Sampling location

Following table shows the locations from which water samples were taken.

Table 3: geocoordinates of water sample location

Location	Longitude	Latitude
Proposed Powerhouse location	73.04077932900633	0.2949857081451479
Coral Garden	73.04144106349672	0.2928351793535069
Naatakuge	73.04123818507773	0.2919886184504105



Figure 16: water sample locations

4.8.3 Results

Table 4: water sample results

Location	Proposed Powerhouse location	Naatakuge	Coral Garden	Optimal Range	Reference
Conductivity($\mu\text{s}/\text{cm}$)	1493	1294	487	<1500	EPA
pH	7.33	7.40	8.25	6.5-8.5	EPA
Salinity (‰)	0.75	0.65	0.24	NA	EPA
Temperature($^{\circ}\text{C}$)	22.7	22.6	22.7	NA	EPA

Total Petroleum Hydrocarbon (mg/L)	0.06	0.06	0.09	<5NTU	EPA
Turbidity (NTU)	169	0.270	0.311	NA	EPA

pH, Conductivity and Turbidity is within the EPA drinking water optimal range. Conductivity is very high in certain areas of the island (1294 $\mu\text{s}/\text{cm}$ near Naatakuge). Conductivity is highest at the proposed powerhouse location (1493 $\mu\text{s}/\text{cm}$) as the area was a wetland before. Further, hydrocarbons are present at a concentration of 0.09 mg/L near the existing powerhouse.

4.9 Vegetation

4.9.1 Method

The vegetation cover at the proposed powerhouse location was determined visually. All the trees within the site were counted. The geo-coordinates of the proposed powerhouse location is shown in table 5.

4.9.2 Results

There are 39 *Cocos nucifera L.* within the plot given for the development of powerhouse location. High density of *Cyperus polystachyos* was found growing around the wetland, shown in figure below. One *Pandanus tectorus*, 9 *Musa paradisiaca sapientum* and two *Zizyphus mauritinia* were also found on the site.



Figure 17: high density *Cyperus polystachyos* growing around the wetland

The plot has already been very much cleared. The types of plant remaining on the plot is shown on table 6.

Table 5: geocordinates for proposed powerhouse location

Location	Longitude	Latitude
Proposed powerhouse location	73.04077932900633	0.2949857081451479

4.9.1 Dhivehi names for the vegetation

Table 6: Dhivehi and scientific names for plants

Scientific Name	Dhivehi Name
<i>Panicum maximum</i>	<i>Onuhui</i>
<i>Cyperus polystachyos</i>	<i>Kiruthundi / kunaa hai</i>
<i>Cocos nucifera L.</i>	<i>Ruh</i>
<i>Pandanus tectorus/ P.zeylanicus</i>	<i>Boa kashi keyo</i>
<i>Scaevola taccada</i>	<i>Magoo</i>
<i>Musa paradisiaca sapientum</i>	<i>Faiykeyo gas</i>
<i>Wedelia calendulaceae/W.biflora</i>	<i>Mirihi</i>
<i>Hibiscus tiliaceus</i>	<i>Dhiggaa</i>
<i>Zizyphus mauritinia/Z.jujuba</i>	<i>Kunnaaru</i>



Figure 18: types of plants in plot given for powerhouse development

4.10 Noise level

4.10.1 Method

Noise level was measured using a hand held decibel meter. The maximum and minimum readings were recorded at the powerhouse and near the closest residential area. The geo coordinates of the locations are shown below.

Table 7: geocordinates of noise level measurement locations

Location	Longitude	Latitude
Existing powerhouse 1	73.04154304040655	0.29275970221693
Existing powerhouse 2	73.04154674006566	0.2926687172327799
Ranbusthaanuge 4	73.04144065396127	0.2927782965186121
Proposed powerhouse location 5	73.04075247883002	0.2946745181421274
Proposed powerhouse location 7	73.04103364700511	0.2946964100792286
Proposed powerhouse location 6	73.04095087915385	0.2949851525229093
Farivaage 8(nearest residential house)	73.0407810062466	0.2936806792427615



Figure 19: noise level measurement locations

4.10.2 Results

Table 8: results of noise level measurements

Location	Noise level (db)	
	Minimum	Maximum
Existing powerhouse 1	73.1	74.5
Existing powerhouse 2	85.8	88.7
Ranbusthaanuge 4	66.1	68.6

Proposed location 5	powerhouse	33.1	37.1
Proposed location 7	powerhouse	35.3	35.6
Proposed location 6	powerhouse	33.1	37.1
Farivaage residential house)	8(nearest)	37.8	41.1

Noise level within the vicinity of the existing powerhouse is very high. It is because the generators are not inside a standard powerhouse that the noise level within the nearest residential area also high. Noise level near the proposed powerhouse location is very low (33.1 db).

4.11 Air quality

4.11.1 Method

Air quality was measured using wolfsense air quality meter. Readings were recorded at the existing powerhouse and near the proposed powerhouse location. The geo coordinates of the locations are shown below.

Table 9: geocordinates of air quality measurement locations

Location	Longitude	Latitude
Air quality location 1 (existing powerhouse)	73.04153653202113	0.2926865711781148
Air quality location 2 (near existing powerhouse exhaust)	73.04156189490227	0.2927845492444339
Air quality location 3 (proposed powerhouse)	73.04069650487723	0.2946766591143829



Figure 20: air quality measurement locations

4.11.2 Results

Table 10: air quality results

Location	Parameters				
	No ₂ / ppm	Nitric Oxide / ppm	So ₂ / ppm	Ozone / ppm	
1	0	0	0	0	
2	2	0	0	0	

3	0	0	0	0	
---	---	---	---	---	--

Nitrogen dioxide was found at 2 ppm concentration near the exhaust chimney of the existing powerhouse. Nitric Oxide, Sulpur Dioxide and Ozone was not found in any location.

4.12 Socioeconomic

4.12.1 Demography

Population

Following table shows the population of Nadella as of end of March 2016. Data was provided from Nadella Council.

Table 11: population details of Nadella

Gender	Number
Male	561
Female	539
Total	1100

Sex ratio

$$561/539 \times 100 = 104.08$$

Density

$$1100/422000 \text{ m}^2$$

$$= 0.0026 \text{ people per m}^2$$

Growth

Following calculation shows the population growth of Nadella over the past one year.

$$(1095-1087)/1087 \times 100$$

= 0.74%

4.12.2 Community needs

Nadella council highlights that the most important needs right now for the island is Sewerage services and improvements in education.

4.12.3 Main economic activities

Most of the locals work in nearby resorts for income generation. Fishing and agriculture is also practiced to a lesser extent. Sea cucumber and reef fishery is the main existing fishery. Agriculture is done at island level. However coconuts are exported to Male’, an estimated 1000 nuts per month.

4.12.3 Proposed projects

Council highlighted that a waste management center, youth futsal pitch, volley court, *bashi* court is proposed to be developed in the near future.

5.0 LEGISLATIVE AND REGULATORY CONSIDERATIONS

5.1 Law on general public services (4/96)

Under this law the general public services are electricity, telephone, water and sewerage services.

Article 3 states that any party can provide general public services only after getting registered in the competent authority and according to its regulations.

Article 4 states that any public service must be provided after a contract agreement has been made between the service provider and the customer. The agreement must be made according to the regulations put forward by the competent authority.

Article 5 states that a transfer of service between customers must be made only after a contract has been made between the customers according to the service providers regulations. If the customer fails to comply with the agreement, the service provider can discontinue service only after approval from competent authority.

Article 7 states that the service provider can permanently discontinue its services according to regulation mentioned in article 3 of this law. However temporary discontinuation can be made after giving prior notification to the customers and according to the agreement made between the service provider and the customer.

Article 8 states that the tariffs for the services must be approved from the competent authority prior to implementation. Further, any amendments to tariff structure also must be approved from the competent authority before implementation.

Article 9 states that any damage made to service provider’s facilities by anyone, he can be charged with 10 prison penalty or banishment. Further any action against this law (excluding what is mentioned in article 9(a) of this law) can be charged between MVR 100 to MVR 5000 by the competent authority.

5.2 Law on Environmental Protection and Preservation of the Maldives (4/93)

The Maldives law of environmental protection and preservation was enacted to protect the environment and its resources for the current and future generations.

Article 2 states that the instructions for environmental protection will be given from the competent authority and everyone must respectfully follow these instructions.

Article 3 states that all matters relating to environmental protection and preservation must be handled by the Ministry of planning, human resource and environment.

Article 4 states that Ministry of planning, human resource and environment must declare protected sites and species and formulate the regulations to manage them. If any other party wants to declare a protected site or species they must be registered in the Ministry of planning, human resource and environment and managed according to regulations made by the Ministry.

Article 5 states that any projects which pose significant impacts to the environment, an Environmental Impact Assessment report has to be made and submitted to the Ministry of planning, human resource and environment. The projects which require Environmental Impact Assessment and the regulation must be made by Ministry of planning, human resource and environment.

Article 6 states that if any project is found to cause significant adverse impacts, Ministry of planning, human resource and environment have the right to stop the project.

Article 7 states that any waste, oil or hazardous gas must not be dumped into any part of the Maldives, however if strictly needs to be disposed it should be disposed off in an area designated by the Government. If such hazardous gas, waste or oil is to be disposed by combustion, it should be done in a way it does not impact people’s health and environment.

Article 8 states that any hazardous waste must not be disposed into any part of the Maldives. Before trans-boundary transfer of such waste, approval must be taken from the Ministry of Transport and Communication by writing to the Ministry at least 3 months beforehand.

Article 9 states that anybody who violates this law or any regulation under this law punishable to no more than MVR 100 million according to the offence. The fine will be done by the Ministry of planning, human resource and environment.

Article 10 states that any offence to this law or any regulation under this law or any action resulting in environment damage, the price for such damages can be taken through the judicial processes.

5.3 1st addendum to Environmental Protection and Preservation of the Maldives (4/93) law no 12/2014

Article 3 and 11 of the Environmental Protection and Preservation Act (4/93) of Maldives is amended as follows;

In article 3 all matters relating to environmental protection and preservation must be handled by the Ministry charged with implementation of environmental policy.

5.4 Environmental Impact Assessment Regulation 2012

The EIA Regulation, which came into force in 2007, has been revised and the revised EIA Regulation 2012 is currently in force since May 2012. The Regulation sets out the criteria to determine whether a development proposal is likely to significantly affect the environment and is therefore subject to an EIA. Schedule D of the EIA Regulations defines the type of projects that would be subject to Environmental Impact Assessment. Harbors, dredging and land reclamation is among those. The main purpose of this Regulation is to provide step-by-step guidance for proponents, consultants, government agencies and general public on how to obtain approval in the form of an Environmental Decision Statement.

With the 2nd addendum to the environmental impact assessment regulation 2012 in 30th August 2015, there were some procedural changes made to the EIA process. The most important was the shifting of tourism related development projects EIAs to the Ministry of Tourism. Other than that slight changes were made to the process such as the finalization of the ToR during the scoping meeting(article 11(b)) and changes in the fees for the review processes under three different categories (article 7(c)).

Under article 8(a) the decisions for a screening form is as follows;

- 1) Environment Management Plan
- 2) Initial Environmental Examination
- 3) Environmental Impact Assessment
- 4) Approval to go forth with the screened project
- 5) Approval to go forth with the project according to the mitigation measures proposed by EPA

Under article 9(b) the decisions for an IEE is as follows;

- 1) Environmental Impact Assessment report if the project is anticipated to have major environmental impacts
- 2) Environment Management Plan
- 3) Approval to go forth with the project if the project is not anticipated to have major environmental impacts

Under article 10 two reviewers are required to review the Environmental Management plan. The reviewers are to be selected according to article 13(b) of the regulation.

Since the development of new powerhouse is in the inclusive list, an EIA report needs to be submitted to the competent authority before the implementation of the project. An EIA application form was submitted to the EPA and a scoping meeting was held on 16th March 2016. During the meeting the ToR for the project was issued. The EIA report is this document and will be submitted to EPA for approval.

5.5 Waste management regulation

The waste management regulation dictates the principles needed to follow when handling waste. The aim is to minimize adverse impacts to the environment and human health from waste.

Article 6 states that the waste management hierarchy is as follows;

1. Waste collection
2. Waste transportation by land or air
3. Treatment of waste
4. Storage of waste
5. Management of waste site
6. Landfill
7. Management of hazardous waste

The island councils are required to make a waste management plan and submit it to the competent authority. This plan must be reviewed at least every five years.

Article 8 states that hazardous waste are specified in annex (J) and under no circumstance should it be burned or disposed off in any area of the Maldives. While transporting hazardous waste, it must be in a closed container without any leaks. Further a sign must be on the container, specifying that it is hazardous waste. The import of any hazardous waste to Maldives is an offense.

Article 9 states that depending on the type and volume of waste, if it poses any threat to human health and the environment, the competent authority has the right to declare that particular type of waste as special waste. The current list of special waste is in the annex (B) of this regulation. Under no circumstance should special waste be imported to Maldives, burned, transported, recycled, recovered or treated without prior approval from the competent authority. In order to get the approval, the form in annex (F) of this regulation must be filled and submitted with an administrative fee of MVR 500 to the competent authority. Further, special waste must be stored only in designated places by the competent authority, the design conditions of the storage facility is specified in annex (C) of this regulation.

Article 10 states that the principles regarding extended producer responsibility must be declared and gazette within one year after this regulation comes into force.

Article 11 states that waste generated at islands must be disposed off in areas specified for the purpose or areas approved by competent authority. Disposal of waste to following areas is prohibited under this regulation and is an offense;

- Mangroves
- Island Lagoon
- Reef
- Lagoon(falhu)
- Finolhu
- Beach
- Vegetation line
- Harbor
- Park
- Road

Approval to dispose waste to areas not approved by competent authority will be given under following circumstances;

1. Waste is disposed as a measure to protect human health
2. Situation created by natural disaster or a state of emergency

Approval to manage waste at household level is not required for the following actions;

1. Waste segregation at household
2. Composting at household

Article 12 states that anybody responsible for public sites must place and manage a dustbin. The waste in these dustbins must be managed according to this regulation. Disposal of waste to public sites (besides the dustbin) is an offense.

Article 13 states that any sea vessel must have mechanism to store waste until it reaches a harbor. Upon arrival at a harbor the boat captain must take the waste to an area designated for waste disposal. However biodegradable waste such as kitchen waste and fish mulch can be disposed at sea.

Article 14 states that a waste management system must be established at all harbor's by the operator. A proper system must be in place to manage waste oil and other wastes segregated. Further, the operator must maintain information mentioned in annex (E.) and the records must be made available to competent authority upon request.

Article 15 states that any party who wants to commercially recycle and recover waste, approval must be taken from the competent authority by submitting the form in annex (F) and proposal according to annex (D) of this regulation.

Article 16 states that approval must be taken from the competent authority for the following waste management works

1. Waste collection
2. Transportation of waste by land and sea
3. Waste treatment
4. Storage of waste
5. Management of waste disposal sites
6. Landfill
7. Handling of hazardous waste

The number of waste management approvals for a particular area or areas will be decided by the competent authority based on the following;

1. Waste generation
2. Economic gains from waste management actions
3. Environmental protection requirements for the area

Article 17 states that the parties who get approval to manage waste must operate according to the competent authority’s directions under article 6 of this regulation. Any action not mentioned in the article 6 can be actioned by prior discussion and approval from the competent authority in order to protect health and environment. Such actions by the island council or city council must be advertised publicly.

Article 18 states that the approval for waste management must be given for a set duration. The proponent must apply for renewal of the approval before 3 months of approval due date. Approval will be renewed only if the proponent actions were according to the conditions of the given original waste management approval.

Article 19 states that if a proponent wishes to do more than one of the works mentioned in article 16(a) of the regulation, they can submit a single form for all the works.

Article 20 states that if a proponent wishes to transfer the waste management approval to another party, then they must submit the form in annex (G) and submit any further information the competent authority requests. Within 30 days of submission of the form, the competent authority will issue the approval.

Article 21 states that if a proponent wishes to terminate an approval, they must submit the form in annex (H) of this regulation. The approval will be terminated after the competent authority has ensured that the waste management actions have been done according to the regulations by the proponent.

Article 22 states that an administrative fee (mentioned in annex-J of this regulation) has to be paid to the competent authority while applying for waste management approval.

Article 23 states the proponent can take a fee from the customer given that the fee structure is approved from the competent authority. The proponent can make a distinction in the maximum price for houses and business category. The declared fee structure must be advised publicly to the customers.

Article 24 states that the competent authority must maintain a record of the approvals given.

Article 25 states that when transporting waste the best practices outlined in article 6 of this regulation must be strictly followed. Waste generated at inhabited islands and islands given for commercial use must be transported to the regional waste management facility.

Article 26 states that the parties given approval to transport waste must abide by the following;

1. Before transporting waste to a particular site, they must ensure that the type of waste is allowed to be disposed to the site
2. Records of waste transportation must be maintained according to annex (E) of this regulation and these records must be provided to competent authority when they are requested.

Transport of waste to disposal site from households by another party without giving a fee, is excluded from this article.

Article 27 states that before transport of hazardous out of Maldives, approval must be taken from the competent authority by submitting the form in annex (G) of this regulation before 3 months of the transportation date. When applied for this approval, the competent authority will respond according to the following;

1. Rejection, if the activity is against any principles made by the competent authority under article 6 of this regulation or any international treaties signed by Maldives
2. Resubmission of form, if there is missing information or if the credibility of the information submitted is questionable.
3. Approval, if the activity is accordance with the principles made by the competent authority under article 6 of this regulation and international treaties signed by Maldives.

Approval given under this regulation does not mean that any other approval required from other countries will not be required.

Article 28 states that before transport of hazardous waste through any area of Maldives, approval must be taken from the competent authority by submitting the form in annex (L) of this regulation before 3 months before waste arrive in Maldivian waters. When applied for this approval, the competent authority will respond according to the following;

1. Rejection, if the activity is against any principles made by the competent authority under article 6 of this regulation or any international treaties signed by Maldives
2. Resubmission of form, if there is missing information or if the credibility of the information submitted is questionable.
3. Approval, if the activity is accordance with the principles made by the competent authority under article 6 of this regulation and international treaties signed by Maldives.

Approval given under this regulation does not mean that any other approval required from other countries will not be required. Any vessel that enters Maldivian waters through the approval in this article must not dock in any area of the Maldives. Further if a need arises to inspect the vessel, the party who got the approval must arrange it.

Article 29 states that the party in charge of the management of waste disposal sites must take the approval from the competent authority according to the article 6(a) of this regulation. The management must submit the form in annex(E) of this regulation every 4 months. If the people who come to dispose waste does not go against the principles set by the waste disposal site management, refusing to accept their waste is an offense. The waste disposal site managers must publicly advertise the service hours and rules.

Article 30 states that the competent authority must maintain the records of administrative decisions.

Article 31 states that the competent authority must inspect the waste management sites. Inspection shall be done according to an inspection schedule made by the competent authority. The official from the competent authority may present his monitoring license and then do the monitoring of the site. After inspection of a site, the competent authority must compile an inspection report according to annex (M) and send it to the managers of the site within 7 days. The inspection report must contain any corrective actions to be taken with the due dates for the actions. The managers of the site must implement any corrective actions on specified in the inspection report on due time.

Article 32 states that the competent authority must maintain a database containing information about waste generation (at island level, regional level and country level), type of waste and treatment processes.

Article 33 states that the competent authority must submit a report based on the information on the database mentioned in article 32 annually.

Article 34 states that not following any action mentioned in this regulation is an offense. Further doing any of the following is punishable under EPPA 4/93 article 9(b). The penalty for these offenses will be determined according to annex-(N).

- Import of special category waste or hazardous waste to Maldives
- Transport or treatment of special category waste without prior approval from competent authority
- Disposal of waste to any site which is not approved for waste disposal from competent authority
- Refusing to allow customers to dispose their waste when they have not gone against any rules set by the waste management site managers.
- For any works requiring approval carrying out the works without approval from competent authority
- Managing waste against the principles set under this regulation
- Handling waste against the principles set under this regulation
- Transport of hazardous waste out of Maldives without prior approval from competent authority
- Managing waste against the conditions of a given waste management approval
- Failure to provide information or providing wrong information by any party given approval for waste management
- Failure to manage a public site according to article 12(a) of this regulation by the party responsible for the management of the public site

Doing any of the following is punishable under EPPA 4/93 article 9(a).

- Disposal of waste to an area under article 11(b) of this regulation
- Disposal of waste to a public site (other than the dustbins specified for waste disposal in the area)

The fines for the offenses under this regulation will be decided by the Ministry. The fines will have to be paid to the respective island or city council in the area where the offense was done.

Article 35 states that the competent authority has the right to terminate any approval given under article 16(a) of this regulation with reference to the following;

1. The competent authority finds enough evidence for the incompetence of the waste managers.
2. The works are against this regulation or any other laws

3. Failure to correct the problems mentioned in the inspection report submitted according to article 31 of this regulation

Article 36 states that the arbitration for a decision by competent authority must be made in writing to Ministry within 10 working with a full justification. The reply for the arbitration must be informed within 30 working days by the Ministry.

5.6 Regulation on provision of electricity to Male’ and islands

This regulation is made in accordance to article 3 of law on general public services (number 4/93).

Article 1 states that electricity service can be given only after the service provider is registered in MEA.

Article 2 states that an agreement has to be made between the service provider and the customer for the provision of electricity services.

Article 3 states that any MEA approved electricity service provider can give their ownership to another party only after getting approval from MEA. If any customer wants to change ownership then they must get the approval from the electricity service provider and also make an agreement.

Article 4 states that if a customer breaches the agreement in any way, electricity services must be discontinued after getting approval from MEA.

Article 5 states that for any reason electricity services can only be completely discontinued after getting approval from MEA. However temporary discontinuation of services for the purpose of maintenance work or in accordance with the agreement made between service provider and customer is acceptable under this regulation. In such a case also the customer must be notified in advance. Nonetheless emergency discontinuation of electricity is excluded.

Article 6 states that the tariff for electricity must be approved from MEA.

Article 7 states that the regulations under the agreement between electricity service provider and customer must be approved from MEA.

Article 8 is about the technical specifications of powerhouse. The following is stated under this article;

- The engine must be mounted on a foundation and anti-vibration should be also mounted between the engine and the foundation.
- The exhaust pipe must be 24 feet high from ground if the power house is 14 feet high. For powerhouse higher than 14 feet, the exhaust must be at least 4 feet higher than from the highest point of the roof.

- The power house must be constructed and maintained in a fire resistant manner with walls fabricated and iron roofing.
- The powerhouse must be constructed 200 feet away from the nearest residential area. If there is not enough space available in an island then MEA will declare the area for powerhouse construction.
- The ventilation of the powerhouse must be such that when all the engines are operational the difference in temperature inside and outside the powerhouse must be less than 10 °C compared to ambient temperature.
- Power house construction, fuel storage and handling must be in accordance with pertinent regulations. If there is not pertinent regulation such an activity must be done after consulting with the relevant Ministry and there decision must be submitted to MEA.
- Firefighting equipment must be in accordance to NSS specifications.
- Powerhouse must be wired according to article 12 of this regulation.
- Fire safety notifications must be pasted on easily seen areas of the powerhouse.
- Emergency lights must be mounted such that works inside powerhouse can be done during a power outage.

Article 9 is about the technical specifications of control room, switch board, and distribution feeder. The following is stated under this article;

- Control room and distribution feeder must be in accordance to MEA approved drawings.
- Switch board and panel board must be constructed to MEA standards and must be tested from MEA and approval must be obtained. Wiring details must be submitted.
- Switch board rear end and sides must be closed in way people do not get electrocuted.
- The switch board must include and fulfill the following;
 - Incoming breaker: must be capable of taking 10% – 50% of generated rated current
 - Incoming indication light
 - Phase neutral and phase voltage must be visible
 - Three phase ampere must be visible
 - Able to see generator frequency
 - Able to see generator kilowatt
 - Able to generator energy
 - Earth float protection
 - Breakers capable of handling load for outgoing feeders
 - If there is more than one generator, synchronizing panel or change over switch with capacity to handle 125% of largest generator
- Drawings of panel wiring must be pasted in control room or any other visible area.
- Drawings for First aid instructions must be pasted on control room and engine room.
- Firefighting equipment’s must be readily available to staff in control room

Article 10 is about the technical specifications of the distribution system. The following is stated under this article;

- At any point on the distribution, voltage must not be less 10% of generated voltage
- If distribution is to be made via overhead cables then the drawings must first approved from MEA. The poles can be either metal or wood with a diameter of 4 inches.
- The distance between two poles must be a maximum of 75 feet. The poles must be 1.5 feet from the wall of residential houses.
- The cables must be at least 14 feet from the ground. The distance between the must not be closer than 1 feet.
- Insulation must be in between the cables and the poles. The cables must be capable of handling 25% more of normal load.
- If there are any building as high as the power lane, then the lane must be insulated extending up to 5 feet from the building. After installation of lane it must be maintained to prevent tress from falling over.
- Works must be done on a live lane with proper safety equipment’s like insulated gloves, insulated boots, and safety helmets.
- Work must not be done alone on a live lane. While working on a ladder, the ladder must be secured properly.
- If the distribution system is to be under the ground then the cable technical standard is BS6346 or international accepted standard.
- While laying the cable care must be taken not to damage the outer insulation of the cable. Cable should be buried on 1/3rd of the road at depth of 2.5 feet.
- After laying the cable, before backfilling sand must be laid up to 6 inches height and a tape notifying a cable is below must be laid.
- Cable joints must be done by MEA approved personals. The joint should be made by using heat shrink or resin.
- The distributions box’s single line diagram must be approved from MEA and the box should be constructed in accordance to the diagram.
- The distribution box must be weather proof. The box must be constructed with a non-conductive material and its inside must have holes for air circulation.
- The distribution box must be secured with bolts 3 feet above the ground from the bottom of the box. The house connection cable from the distribution box must be inside a pipe or duct.
- The house connection supplies inside the distribution box must be properly secured such that it does not produce any sparks.
- Every distribution box must have a caution notice saying “Danger 400 V”.

Article 11 is about the technical specifications of the house connections. The following is stated under this article;

- The wiring of the houses must be in accordance with article 12 of this regulation.
- At any customer house, there has to be overload protection (cut out fuse MCB, MCCB), earth float protection (ELCBLR) and isolation (main switch) must be installed.
- To all electricity service provided places, a supply drawing must be made. No connection must be made without a drawing.
- Electricity service must be provided with the installment of a meter. The meter must be tested from an MEA approved place. ELCB must also be installed in this manner.

Article 12 is about the wiring standards. The following is stated under this article;

- Electrical wiring must be done by MEA approved professionals.
- Color codes for single phase wiring is; red for phase, black for neutral, green or green with yellow stripes for earth.
- Color codes for three phase wiring is; red for first phase, yellow for second phase, blue for third phase, black for neutral, and green or green with yellow stripes for earth.
- While three phase wiring, if the colored cables are not available sleeving must be inserted on both ends of the cable to identify the color codes.
- For three phase wiring, the load must be balanced to the 3 phases.
- The earth for a building must be connected using an appropriate thickness for the building. Main earth to the ground must be extruded from the specified area from the main switch or D-Board. A lug must be installment before connection of earth cable to earth rod. Earth must be fixed inside a closable junction measuring 8”x8”.
- In all wiring a D-board, main switch and ELCB must be installed. ELCB must be installed after testing from MEA approved place. In single phase places there must be a minimum of one socket with 2 lightings. In three phase places there must be a minimum of 3 socket with 6 lightings.
- ELCCB rating if single phase;
 - trifing - current 30 mA
 - 240V rated current – 30A to 63A
 - 2 pole
- ELCCB rating if three phase;
 - trifing - current 30 mA
 - 440V or 380V
 - 40A – 63A

- 4 pole
- If a lower rated ELCCB is to be used then its tripping current must not be higher than 30mA.
- All cables to D-board must have a phase and earth cable. The CB or fuse installed must be appropriate to the circuit. It should not be higher than required.
- Only basbar should be used in D-board. Loofing of the cable shall not be done instead of using basbar. Three phase D-board basbar link must be installed with appropriate gap between two phases.
- If cable diameter is 3/029 or 1.5 mm², circuit must have 5 lightings(fans can be included). However the load from this circuit must not exceed 500W. In socket circuits the cable diameter must be higher than 7/029 or 2.5 mm². The circuit must have 2 sockets if cable used has a diameter of 7/029 or 2.5 mm².
- While wiring if 2 or more gang switch is used, not more than one phase shall be connected to the switches(inside the same box).
- In a single phase circuit, instead of 30A main switch a, an MCCB rated higher than 2 pole 40A should not be installed. If three phase circuit, instead of 60A switch , an MCCB rated higher than 60A 4/3 pole should not be installed. If main switch is to be installed on D-board it should be between 5 and 6 feet from ground.
- All cables must be inside a condute pipe or protective piping like plastic pipe. If cables are not inside a pipe it should be secured using cable ties.
- Current for Air condition, freezer, and other higher load appliances must be given from points which is wired on separate circuit.
- Wiring to machineries must be done using appropriate cables via starter or main switch. Starter or main switch must be installed in a nearby area to workplace from where it can be operated easily.
- The installed D-board edge must be no higher than 6 feet.
- Water proof switches must be used in wet places like the toilets. If another type of switch is to be installed it must be in an area where water cannot reach.
- When using sockets without switches, there has to be a switch. Generally sockets without switch is not approved.
- Wirings in huge buildings, between phase neutral, phase earth, neutral earth resistance must be a minimum of 1 mega ohms. For wiring of less than 5 points if the resistance is 1 mega ohms it will not be accepted. For these type of places the resistance must be 10 mega ohms.
- If a customer wants to use a back up generator during an emergency, current shall be used using change over switch. Change over switch must be capable of cutting phase and neutral. Further the rating must be appropriate to the load of the place.

- If a customer wishes to add new wiring to existing MEA approved wiring, then it shall be done by MEA approved personel after wire testing. MEA unapproved wiring must not be connected to D-board.
- If a wiring done by a personel is found to be wrong, the responsibility must be taken by the person who signs on the wire testing form.

Article 13 states that the staff in powerhouses must be properly trained personals for the job. The highest responsible person in the powerhouse must have an MEA approved level of training. All staff in powerhouse must be trained for firefighting. Besides staff other people should not be allowed inside the engine room. Control room staff must have completed the basic fire extinguish and prevention course by Ministry of Defense and National Security.

Article 14 states that all MEA approved wiring professionals must follow this regulation. Wiring done against this regulation will not be accepted. Further, during wire testing if it comes to MEA notice that wiring done by a particular person has many issues his/her license maybe terminated.

Article 15 states that places wired before 1st January 1997 shall be advised to correct its wiring during a given time upon inspections by MEA.

Article 16 states that any breaches to this regulation are punishable by a fine of MVR100 to MVR5000.

5.7 Guideline for power system approval

The guideline for power system approval highlights the set of information required to be submitted to MEA for the approval process. Which includes details about the generation system, generator control panel and distribution panel, fuel system, distribution network, electric cable, firefighting system and lighting protection, environmental impact assessment of the generation facility, tariff and rules and regulations of powerhouse for consumers.

6.0 POTENTIAL IMPACTS AND MITIGATION

The impacts from any project can be categorized into two broad categories; impacts during construction and impacts during operation. Impacts during construction are the potential impacts which might arise during the construction of new powerhouse. Impacts during operation are the potential impacts which might arise during the operation of the new powerhouse.

6.1 Impact identification methodology

The potential impacts were identified by looking in to the proposed works under this project and comparing it with the environmental setting. An impact matrix with reference to magnitude, extent or location, duration, reversibility and likelihood was used to determine the significance of the impacts. Further, expert judgment, field surveys and other similar EIA reports were used as a reference. Table below shows the characteristics of impacts against which it was analyzed.

Table 12: impact characteristics, where 5 is of highest significance.

Characteristic	Impact significance					
	0	1	2	3	4	5
Type	Direct/indirect					
Nature	Negative/positive					
Magnitude	Negligible	low		moderate		High
Extent/location		small area covered		moderate area covered		large area covered
Duration		very short	Short	intermittent	Long-term	continuous
Reversibility			reversible			irreversible
Likelihood	none	low probability		moderate		high probability

6.2 Limitations in impact prediction

While all attempt has been made to accurately predict the potential impacts from this project, there are unforeseen uncertain factors which might causes deviations in the impacts outlined herein. For instance a natural phenomenon.

Further there is the limitation in our knowledge itself about the environment. Even though thorough brainstorming was done to assess the potential impacts there might always be some impact which is not accounted for because it has not been noticed.

In addition there is an information gap; there is limited information about the condition of the marine environment prior to anthropogenic disturbances. This makes it very difficult to ascertain a baseline.

6.3 Impacts during Construction

During construction the primary impact zone would be the powerhouse premise shown on figure below. This would include impacts on quality of air, water and terrestrial environment. The secondary impact zone would extend near to the nearest residential area. This would be impacts on air quality.



Figure 21: impact zone during construction. Orange; is primary impact zone and yellow; is secondary impact zone

6.3.1 Impacts on Air quality

Cranes will be used to lift the generators and move them to the desired location inside the powerhouse. Operation of other general tools during the construction of the power house will require electricity. As the electricity will be supplied from the existing grid of Nadella no additional generators will be required to run. Therefore the fuel burned daily will be very less. Fuel will only be consumed during the operation of the crane during the transfer of the generators. It is estimated that 150 liters of oil maybe expended for this purpose.

Combustion of any type of fuel releases greenhouse gases to the atmosphere, however the volume of greenhouse gases released during the construction phase of this project is insignificant when compared to the amount of greenhouse gases produced in other countries. Further as the site is near the coast, it is expected that any waste gases would not remain stagnant to cause any health implications to the public. Any waste gases produced would be localized to the power house area for a very short time.

The significance of the impacts to air quality was considered low as the magnitude of the impact is low and hence is not expected to cause any significant adverse impacts to the environment and the community.

Mitigation measures

Daily maintenance of machinery

6.3.2 Impacts on water quality

Operation of machinery during construction activity can cause oil and chemicals to be spilled. If chemicals are spilled on to the ground, there is high risk that it will contaminated the groundwater near the power house. Further there is risk of oil spills from the operation of machinery.

Even though the likelihood of this happening are slim, due to its irreversibility the impact is of high significance.

Mitigation measures

Daily maintenance of machinery.

Following chemical handling procedures.

Emergency oil spill cleanup crew on standby during construction.

Follow waste management regulation highlighted in the legal section of this report.

6.3.3 Impacts from Waste

Any waste generated would be localized to the power house area and people working in powerhouse. Although the solid waste from packaging waste would be immediately levitated, once the waste is transported to Thilafushi, the hazardous chemical waste generated pose a high risk to the workers. Therefore the impacts from waste is of moderate significance.

Mitigation measures

Solid waste managed according to waste management regulation.

Waste segregation and stored in closed labelled containers before transfer to Thilafushi.

Health and safety materials made available to workers specifying instructions on how to handle hazardous waste and how to act during a chemical spill to a person.

6.3.4 Impacts on terrestrial environment

It is proposed that only the building footprints will be cleared, the vegetation in all other area will be left. Any small trees which can be replanted will be replanted in another area within the plot given for FENAKA.

Impacts on terrestrial environment will be low as only a few plants will be removed which is strictly on the powerhouse footprint. As the magnitude of vegetation clearance is low, the impact is of low significance.

Mitigation measures

Replanting any small trees within the powerhouse footprint in other areas.

6.4 Impacts summary

Following table shows the impacts summary during the construction phase.

6.5 Impacts during operation

During operations primary impacts would be to the powerhouse. While the secondary impacts would be to the entire Nadella island community as the positive impacts will spread to the entire community.



Figure 22: impact zone during operations. Orange; primary impact zone and green; secondary impact zone

6.5.1 Impacts on water quality

During the operation and maintenance of the generators there is a small risk of water contamination by accidental spills. Impacts from any spills will be localized to powerhouse area and will be irreversible.

Even though the likelihood of an oil spill occurring is low due to the irreversibility of the impact it is of high significance.

Mitigation measures

Regular maintenance of machinery.

- Following chemical handling procedures.
- Staff training on emergency oil spill cleanup.
- Emergency response plans made for powerhouse operation.
- Oil spill cleanup materials made available to the powerhouse.

6.5.2 Impacts on air quality

The operation of the power house is not expected to increase the impacts on air quality as already existing generators will be run at the powerhouse. The operation of the 330 KW generators will produce smoke and greenhouse gases. However as the power house is 700 feet away from the nearest residential house and the location of powerhouse near the coast, it is expected that the smoke will not impact the community in anyway during the SW monsoon. However during NE monsoon smoke maybe blown inland. Even though smoke maybe blown towards the residential houses, it is expected that the disturbance to residents will be minimal as the smoke will be diluted and also will be high above ground as the chimneys of the powerhouse will be 28 feet high.

Due to the low magnitude and location of powerhouse (near coast away from residential area), the impacts on air quality is considered to be of low significance.

Mitigation measures

- Regular maintenance of generators.
- Chimneys constructed according to MEA standard

6.5.3 Noise disturbance

With the operation of new powerhouse the noise disturbance to the community will be levitated completely. Currently the generators are operated in a facility which is in the middle of residential area. But with the operation of new powerhouse the generators will be operated inside a sound proof powerhouse away from residential area.

The powerhouse is located 700 feet away from the nearest residential house, hence noise disturbance to community will be negligible. However the noise level inside the powerhouse will be very high. Therefore the staff working inside the powerhouse will need to wear noise cancellation headphones.

Even though the significance of noise disturbance to community and wildlife is negligible the noise disturbance to staff working in the powerhouse will be high.

Mitigation measures

Wear noise cancellation headphones while inside plant house.

6.5.4 Socio-economic impacts

The new powerhouse will increase the reliability of electricity service of the island. Since the generators in Nadella is currently in a very old facility, it poses risk to the staff working in the facility. With the development of new power house, the noise disturbance to community will be avoided.

Since this impact is a positive long-term impact to the entire island community, it is of high significance.

6.5.5 Health

There are health implications to the staff working in the powerhouse during operations. During the operation and maintenance of the generators and other machinery they will come in contact with grease, oil, grit and other hazardous chemicals. If proper personal protection wears are not worn it will have adverse impacts to the health of staff. However there is little risk if the proper personal protections are worn and established chemical handling procedures are followed.

Mitigation measures

Following chemical handling procedures.

Wear essential personal protection attire at all times.

Health and safety manuals made for the plant.

Staff trainings on chemical handling.

Emergency response plans made for plant operation.

6.5.6 Impacts from Waste

Waste oil generated from the generators pose risk to environment if it is not managed properly. It is estimated that an average of 74.25 liters per month is generated. Currently waste oil is given freely for the locals.

Mitigation measures

Waste oil must be stored in closed labelled containers

6.5.7 Fire hazard risk and safety

During the operation, the risk of fire is always there and will cause a considerable damage to the physical and social environment. Depending on the degree of fire, the impact could be low to very high.

Mitigation measures

The new facility will have firefighting equipment within the power plant house and within the administrative building. In addition, signs for the emergency procedures will have to be in the vicinity clearly marking where the exits and firefighting equipment’s are.

6.6 Impacts summary

Following table shows the impacts summary during the operational phase.

Table 14: summary of impacts during operation

Impact	Impact Characteristics							Significance
	Type	Nature	Magnitude	Extent/location	Duration	Reversibility	Likelihood	
Water quality -oil spills	Direct	Negative	low	Localized to power house area	Long-term	Irreversible	low	high
Air quality -GHG emission	Direct	Negative	Low	Localized to power house area	Long-term	reversible	High	Low
Noise disturbance -noise disturbance to staff	Direct	Negative	Low	Localized to power house inside	Long-term	Reversible	High	High
-noise disturbance to wildlife	Direct	Negative	Low	Localized to power house area	Long-term	Reversible	High	low
-noise disturbance to community	Direct	Negative	Low	Localized to power house area	Long-term	Reversible	High	Negligible

Socio-economic - reliability of electricity services	Indirect	Positive	High	Entire Island community	Long-term	Reversible	High	High
Health -health implications to staff	Direct	Negative	Subjective of the scale of spill	Powerhouse	Short-term	Irreversible	Low	High
Waste -waste oil	Direct	Negative	Moderate	Powerhouse	Continuous	Reversible	Low	High
Fire hazard risk and safety	Indirect	Negative	High	Entire Island community	Continuous	Reversible	Low	High

7.0 ALTERNATIVES

7.1 No project scenario

The no project scenario means that the new power plant will not be installed in Nadella. This would lead to reduced reliability of electricity services to the island. FENAKA would not be able to provide electricity service sustainably to the community and will lead to a loss of credibility of the company. Further the noise and smoke disturbance to the community will remain high.

7.2 Alternative locations for powerhouse

Considering the current land area already given to FENAKA and the location of the existing panel boards and fuel storage, the proposed powerhouse location is the most feasible.

An estimated 80 x 20 feet of the plot given for the powerhouse is wetland area as shown on figure below. Therefore one option is to build the powerhouse on the other side of the plot. Second, compacting the wetland area by dumping sand. This will however cost a lot of time and money.

A third option is to shift the plot Southwards by about 40 feet so that the wetland is avoided. It is important to preserve the wetland as they can be used for agricultural purposes. A second alternative location for the powerhouse is the reclaimed wetland area to the East shown in yellow color on the figure below. However the council has plans to give housing plots from this area. Considering this, and the fact that the land registration has already been done it is best that the powerhouse is developed on the existing plot away from the wetland area.



Figure 23: alternative location for powerhouse. In yellow is the reclaimed wetland area, maroon is the alternative location option 1, orange is alternative location option 2, red is the existing wetland, blue is the given plot for powerhouse, green is the waste disposal area, and purple is the graveyard.

8.0 MONITORING

Monitoring is one of the most essential aspects of EIAs, as only through monitoring can the predicted impacts be confirmed. For negative impacts monitoring allows for the mitigation of these impacts which will allow the prevention or minimization of the negative impacts. For positive impacts monitoring will allow us to determine if the positive impacts are as perceived in the beginning of project allowing to determine the overall success for the project and measures for improvement. Further it will allow us to find any unforeseen impacts. Finally it will allow us to determine if the mitigation measures are working and hence allow us to proposed new mitigation measures.

The baseline data collection for the construction of new powerhouse was conducted on April 2016. Baseline surveys are conducted to determine the reference range, so that comparisons can be made during the monitoring to determine the change.

All monitoring activities must be done under supervision of a registered EIA consultant. The details of the monitoring program are given in the table below.

Table 15: environmental monitoring plan

Parameter	Phase	Method	Indicators	Frequency	Cost / MRF
Groundwater quality	Operation and Construction	Test of groundwater parameters	Hydrocarbons	Every 3 months during construction and every 6 months during operation	800
Noise level	Operation	Noise level measurement using decibel meter	Noise level	Before and after operation	3500

8.1 Monitoring schedule

Monitoring reports must be submitted to EPA as specified in the monitoring schedule below.

Table 16: monitoring schedule

Description	Date
EIA Decision statement issued	April 2016
Monitoring report during construction- 1	June 2016
Monitoring report during construction - 2	August 2016
Monitoring report during construction - 3	November 2016
Monitoring report after project completion- 4	December 2016
Monitoring report after project completion - 5	December 2017
Monitoring report after project completion - 6	December 2018
Monitoring report after project completion - 7	December 2019
Monitoring report after project completion - 8	December 2020

9.0 STAKEHOLDER CONSULTATIONS

9.1 Public Consultation

10 individuals from 9 different houses were consulted. Their names and concerns are summarized below.

Table 17: details of individuals consulted

Name	House	Contact
Ali Hassan	Coral Garden	7823224
Aminath Mohamed	Ranbusthaanuge	
Anoof Ibrahim	Farimage	9849059
Ahmed Naahiz	Lady bird	7883398
Jaisham Mohamed	Fennamaage	7449529
Aishath Shimla	Februaryge	7667187
Shifaazu Mohamed	Februaryge dhekunubai	
Aishath Mohamed	Hilihilaage	
Mohamed Moonis	Faalsaage	9704087
Zuha Mohamed	Faalsaage	

All the individuals consulted felt very positive about the project and feels strongly that the new powerhouse is need. Almost all individuals within the vicinity of the existing powerhouse said they faced noise and smoke disturbance from the existing powerhouse on a daily basis. The trees in the houses within the near vicinity of the existing powerhouse were covered in soot. Further, according to some of individuals consulted smoke and soot from the existing powerhouse comes inside their houses with the wind. Due to the soot, the sofas and tables outside needs to be cleaned at least once a day. In addition the houses within the vicinity of the existing powerhouse are not able to harvest rainwater as the soot from the powerhouse settles on the roof. They also claim there

are traces of oil on their roof when they clean. The neighbors also believe some of the members of their family migraines are linked to the smoke and noise disturbances.

Further there was individual who claimed that due to the vibration from the existing powerhouse, his house has been damaged and crack lines formed. Figure below shows the crack lines the individual claims to have been due to the vibrations. According to him he moved out of the house due to the noise and smoke disturbance and also filed a court case against the powerhouse to claim the damages inflicted to him but the case was rejected. He strongly feels that the decision made against him was because the powerhouse is a government entity and that he was sidelined.



Figure 24: crack lines in house

9.2 Meeting with the island council

Following is the list of council members who participated in the meeting with the council and the summary of the discussion.

Table 18: attendees of council meeting

Name	Contact
Faisal Najeeb	7783004
Ahmed Amir	9884654
Mohamed Moonis	
Ibrahim Abdul Kareem	7866299
Ali Niyaz	9972005

Regarding the clearance of land, the council highlighted that compensation had been given to the respective owners of the 39 coconut trees in the proposed powerhouse land.

The council highlighted that from the existing powerhouse dust, smoke and noise disturbances are being made to the residents within the vicinity of the existing powerhouse. The council assured that the new proposed powerhouse location is 700 feet away from the nearest residential house. They also highlighted that no new houses will come to within 200 feet of the proposed powerhouse location in the future.

Regarding the socio-economic’s of the island, council highlighted that the main income for the community is from working in the nearby resorts, sea cucumber fishery, reef fishery, and to a lesser extent agriculture. Agricultural products are harvested to the extent only they are able to cater for the island only. However Banana’s, *Kurumbaa* and *Kaashi* are exported to Male’. An estimated 1000 coconuts is exported to Male’ per month. Future developments planned include a waste management centre, youth futsal ground, Volley court and *Bashi* court. The community is most in need of sewerage services and good education as currently Nadella School can teach up to grade 10.

Council highlighted there is a unique habitat on the NW corner of the island, which is a *kulhi*. In the dry seasons the *kulhi* is mostly dry, the only water is at the deepest part of the *kulhi*, which is the North end. Further, the water in the *kulhi* is not saline and there are *beyngu* during the wet season when the *kulhi* is flooded.

9.3 Consultations with working staff on site

Following is the list of staff who participated and assisted in the surveys with the EIA team. Their concerns are highlighted below.

Table 19: details of staffs that were consulted.

Name	Designation	Contact
Shahumadh Azeez	Supervisor	7569555
Zakariyaa Hassan	Laber	7594364
Ahmed Rasheed	Technision	7444005
Ahmed Ali	Station Manager	9876340
Mariyam Shimnaa	Account Officer	9141434
Mohamed Shaaneez	Officer	9174111

All staff working in the existing powerhouse said that they are very much in need of a new powerhouse as the existing building is outdated and not safe to work in. Further, there is no diesel storage and hence the fuel is stored in *fifa*'s. In many instances these containers were found to crack and the fuel leaked.

The only concern they have regarding the new proposed powerhouse house is the location. As a third of the land allocated is wetland, a lot of time and money will be consumed to take sand and compact the area. And hence their main concern is, this might cause a delay in the development of the new powerhouse. They feel that the issue can be solved by moving the allocated land 50 feet SW of the current location. They believe this location to be the most feasible as the new network grid cable ends are there and hence can be connected without much costs.

10.0 CONCLUSION

Works presented in this EIA does pose a risk to environment and people working. Therefore it is highly recommended that the mitigation measures proposed in this report is strictly followed during the construction and operational phase.

It is important to highlight that this project is very much needed for Nadella as the community is currently under a lot of noise and smoke disturbance from existing powerhouse. In addition, as the existing powerhouse is not in accordance with current standards.

With the development of new powerhouse the disturbance to community can be almost decreased to zero. Further, it is expected that the development of powerhouse will greatly increase the electricity security at Nadella. Furthermore the project will allow sustainable provision of electricity to the residents of Nadella by FENAKA. This will undoubtedly improve the public perception of the company.

11.0 REFEEERENCES

1st amendment to environmental protection and preservation of the Maldives(4/93). (2014).

Retrieved from <http://www.mvlaw.gov.mv/pdf/ganoon/chapterIV/12-2014.pdf>

Kohler, K.E. & Gill, S.M., 2006. Coral Point Count with Excel extensions (CPCe): A Visual Basic program for the determination of coral and substrate coverage using random point count methodology. *Computers & Geosciences*, 32(9), pp.1259-1269. Available at:

<http://linkinghub.elsevier.com/retrieve/pii/S0098300405002633> [Accessed March 12, 2012].

Law on environmental protection and preservation of the Maldives. (1993). Retrieved from

<http://www.mvlaw.gov.mv/pdf/ganoon/chapterIV/4-93.pdf>

Law on general public services. (1996). Retrieved from

<http://www.mvlaw.gov.mv/pdf/ganoon/chapterII/4-96.pdf>

Maldives Energy Authority. (n.d.). Regulation on provision of electricity to Male' and Islands.

Retrieved from http://www.energy.gov.mv/v1/wp-content/files/lawsandregulations/D02-Downloads-MEA_Qawaaidhu01.pdf

Maldives Energy Authority. (n.d.). Guideline for powers system approval. Retrieved from

<http://www.energy.gov.mv/v1/wp-content/files/downloads/D03-Downloads-Guideline for Power System Approval-Rev200907091230.pdf>

Maldives Meteorological Centre. (2015). Climate of Maldives. Retrieved December 30, 2015,

from <http://www.meteorology.gov.mv/climateofmaldives>

Maldives Meteorological Service. (2015). *Daily Rainfall Data.*

President Office of Maldives. (2012, May 8). Environmental impact assessment regulation 2012.

Gazette of Maldives, 41(81). Retrieved from

<http://www.mvlaw.gov.mv/pdf/gavaid/minHousing/R27-2012.pdf>

President office of Maldives. (2013, April 9). 1st amendment to environment impact assessment regulation. *Gazette of Maldives*, 42(56). Retrieved from

<http://www.mvlaw.gov.mv/pdf/gavaid/minHousing/R18-2013.pdf>

President office of Maldives. (2013, August 5). Waste management regulation. *Gazette of Maldives*, 42(113).

President office of Maldives. (2015, August 30). 2nd amendment to environmental impact assessment regulation. *Gazette of Maldives*, 44(261). Retrieved from

http://epa.gov.mv/index.php?option=com_content&view=article&id=89:environmental-impact-assessment-regulation-2007&catid=10:environmental-regulations&Itemid=20

LIST OF ABBREVIATIONS

MEE	Ministry of Environment and Energy
EIA	Environmental Impact Assessment
EPA	Environmental Protection Agency
MEA	Maldives Energy Authority
NSS	National Security Service (currently known as Fire and Rescue)
NE	North East
SW	South West
mA	milli ampere
ELCCB	Earth leakage circuit breaker
ELCB	Earth leakage circuit breaker
V	Voltage
A	Ampere
CB	Circuit breaker
MCCB	Molded case circuit breaker
mm	millimeter
W	Watt
MW	Mega Watt
CSR	Corporate Social Responsibility

Terms of Reference (ToR)



Terms of Reference for Environmental Impact Assessment for Relocating powerhouse at G.Dh Nadella

The following is the Terms of Reference (ToR) following the scoping meeting held on 16th March 2016, for undertaking EIA for relocating powerhouse at G.Dh Nadella. This ToR is based on the draft ToR submitted by the consultant on 3rd March 2016. The Proponent of this project is Fenaka Cooperation Limited. While every attempt has been made to ensure that this TOR addresses all of the major issues associated with development proposal, they are not necessarily exhaustive. They should not be interpreted as excluding from consideration matters deemed to be significant but not incorporated in them, or matters currently unforeseen, that emerge as important or significant from environmental studies, or otherwise, during the course of preparation of the EIA report

- 1. Introduction and rationale** – Describe the purpose of the project and, if applicable, the background information of the project/activity and the tasks already completed. Objectives of the development activities should be specific and if possible quantified. Define the arrangements required for the environmental assessment including how work carried out under this contract is linked to other activities that are carried out or that is being carried out within the project boundary. Identify the donors and the institutional arrangements relevant to this project.
- 2. Study area** – Submit a minimum A3 size scaled plan with indications of all the proposed infrastructures. Specify the agreed boundaries of the study area for the environmental impact assessment highlighting the proposed development location and size. The study area should include adjacent or remote areas, such as relevant developments and nearby environmentally sensitive sites (e.g. coral reef, sea grass, mangroves, marine protected areas, special birds site, sensitive species nursery and feeding grounds). Relevant developments in the areas must also be addressed including residential areas, all economic ventures and cultural sites.
- 3. Scope of work** – Identify and number tasks of the project including preparation, construction and decommissioning phases. The following tasks shall be completed:

Task 1. Description of the proposed project – Provide a full description and justification of the relevant parts of the project, using maps at appropriate scales where necessary. The following should be provided (all inputs and outputs related to the proposed activities shall be justified):

The main activities works are:

- Land clearance for infrastructure installation;
- Project management (include scheduling and duration of the project and life span of facilities; communication of construction details, progress, target dates, construction/operation/temporary labour accommodation, access to site, safety, equipment, waste management (including construction waste, fuel waste etc) and material storage, fuel management and emergency plan in case of spills).

Environmental Protection Agency
Green Building, 3rd Floor, Handhuvaaree/Hingun
Male', Rep. of Maldives, 20392
Tel: [+960] 333 5949 [+960] 333 5951
Fax: [+960] 333 5953

ދިވެހިސަރުކާރުގެ ގެޒެޓް
ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
20392
ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
Email: secretariat@epa.gov.mv
Website: www.epa.gov.mv



Power plant design

- Location and capacity of generators and facility;
- Access to power plant;
- Sound attenuation measures;
- Emergency power supply plan;
- Consideration of energy efficiency in power generation

Fuel Management

- Volume required for plant operation;
- Rate of waste lube oil generation its collection, storage and disposal;
- Fuel storage tank details (size, location,);
- Pipeline drawings and specifications especially leakage proofing;
- Measures of fuel containment
Method of fuel transport from harbour to storage

Hazard vulnerability

- Fire, electrical and explosion hazard
- Vulnerability of area to flooding and storm surge.

Health and safety

- Availability of basic first aid facilities
- Availability of safety gears
- Fire fighting capability of powerhouse operators or fire warden.

Task 2. Description of the existing environment – Assemble, evaluate and present the environmental baseline studies/data regarding the *study area and timing of the project* (e.g. monsoon season). Identify baseline data gaps and identify studies and the level of detail to be carried out by consultant. Consideration of likely monitoring requirements should be borne in mind during survey planning, so that data collected is suitable for use as a baseline. As such all baseline data must be presented in such a way that they would be usefully applied to future monitoring. The report should outline detailed methodology of data collection utilized.

The baseline data must be collected before construction and from at least two benchmarks. All survey locations shall be referenced with Geographic Positioning System (GPS) including water sampling points, reef transects, vegetation transects and manta tows sites for posterior data comparison. Information should be divided into the categories shown below:

All data must be collected as per the requirements of the EPA Data Collection Guidelines (published on www.epa.gov.mv). The report should outline detailed methodology of data collection utilized.

Environmental Protection Agency
Green Building, 3rd Floor, Handhuvaree/Hingun
Male', Rep. of Maldives, 20392

ދިވެހިސަރުކާރުގެ ގެޒެޓް
ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
20392
ފޯން: [960] 333 5949
ފެކްސް: [960] 333 5953
އިމެއިލް: secretariat@epa.gov.mv
ވެބްސައިޓް: www.epa.gov.mv

Fer: [960] 333 5949 : ފޯން: 2 of 6
Po: [960] 333 5953 : ފެކްސް
Tel: [960] 300 7555 : ފޯން: 20392
Fax: [960] 332 7555 : ފެކްސް

އިމެއިލް: info@fenaka.com.mv
ވެބްސައިޓް: www.fenaka.com.mv



- Population access to power (will access to power improve?) Employment and economic opportunities and diversification;
- Impacts on human health;
- Impacts from ground water contamination, if any;
- Impact equity (economic activities, employment, income);
- Social destabilization of the island community, and
- Monitoring of socioeconomic and demographic development.

Absence of facilities in the country to carry out the water quality tests will not exempt the proponent from the obligation to provide necessary data. The report should outline the detailed methodology of data collection utilized to describe the existing environment.

Task 3. Legislative and regulatory considerations – Identify the pertinent legislation, regulations and standards, and environmental policies that are relevant and applicable to the proposed project, and identify the appropriate authority jurisdictions that will specifically apply to the project. Legal requirements.

Task 4. Potential impacts (environmental and socio-cultural) of proposed project, incl. all stages – The EIA report should identify all the impacts, direct and indirect, during and after construction, and evaluate the magnitude and significance of each. Particular attention shall be given to impacts associated with the following:

Impacts on the natural environment

- Impacts of noise, vibration and disturbance;
- Impacts on ground water quality;
- Impacts on soil;
- Impacts on landscape integrity/scenery.

Impacts on the socio-economic environment

- Impacts on housing prices and availability;
- Impacts on employment, income and economy diversification;
- Impacts of increased demands on utility services especially water and energy and waste management;
- Impacts on transportation;
- Social destabilization of community;
- Traffic impacts;
- Impacts on nearby buildings;

Construction related hazards and risks

- Pollution of the natural environment (e.g. oil spills, discharge of untreated waste water and solid waste, including construction waste);
- Risk of accidents and pollution on workers and local population, and

Environmental Protection Agency
Green Building, 3rd Floor, Handhuvaree/Hingun
Male', Rep. of Maldives, 20392

ދިވެހިސަރުކާރުގެ ގެޒެޓް
ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
20392

Handwritten signature

Fer Tel: [+960] 333 5949 [+960] 333 5951
Po Fax: [+960] 333 5953

Email: secretariat@epa.gov.mv
Website: www.epa.gov.mv

Male', Republic of Maldives
Tel: [960] 300 7555
Fax: [960] 332 7555

20392
Email: info@fenaka.com.mv
Website: www.fenaka.com.mv



- Impacts on social values, norms and belief due to construction workers on local population.
- Potential damage to surrounding buildings during construction

The methods used to identify the significance of the impacts shall be outlined. One or more of the following methods must be utilized in determining impacts; checklists, matrices, overlays, networks, expert systems and professional judgment. Justification must be provided to the selected methodologies. The report should outline the uncertainties in impact prediction and also outline all positive and negative/short and long-term impacts. Identify impacts that are cumulative and unavoidable. Use interaction matrices (E.g. Leopold Matrix) to assess the magnitude and significance of the impacts.

Task 5. Alternatives to proposed project – Describe alternatives including the “no action option” should be presented. Determine the best practical environmental options. Alternatives examined for the proposed project that would achieve the same objective including the “no action alternative”. This should include alternative location, construction technologies, taking into account environmental, social and economic factors. The report should highlight how the location was determined. All alternatives must be compared according to international standards and commonly accepted standards as much as possible. The comparison should yield the preferred alternative for implementation. Mitigation options should be specified for each component of the proposed project.

Task 6. Mitigation and management of negative impacts – Identify possible measures to prevent or reduce significant negative impacts to acceptable levels. These will include both environmental and socio-economic mitigation measures with particular attention paid to sedimentation control and future changes in coastal processes. Measures for both construction and operation phase shall be identified. Cost the mitigation measures, equipment and resources required to implement those measures. The confirmation of commitment of the developer to implement the proposed mitigation measures shall also be included. An Environmental management plan for the proposed project, identifying responsible persons, their duties and commitments shall also be given. In cases where impacts are unavoidable arrangements to compensate for the environmental effect shall be given.

Task 7. Development of monitoring plan (see appendix)– Identify the critical issues requiring monitoring to ensure compliance to mitigation measures and present impact management and monitoring plan for ground water and sea water quality as well as marine ecosystem monitoring. Ecological monitoring will be submitted to the EPA to evaluate the damages during construction, after project completion and every three months thereafter, up to one year and then on a yearly basis for five years after. The baseline study described in task 2 of section 2 of this document is required for data comparison. Detail of the monitoring program including the physical and biological parameters for monitoring, cost commitment from responsible person to conduct monitoring in the form of a commitment letter, detailed reporting scheduling, costs and methods of undertaking the monitoring program must be provided.

* This TOR contains an outline of the parameters that have to be tested (see appendix). All projects are different, therefore additional or less data will be collected for recovery and impact assessments.

Environmental Protection Agency
Green Building, 3rd Floor, Handhuvaree/Hingun
Male', Rep. of Maldives, 20392

ދިވެހިސަރުކާރުގެ ގެޒެޓް
ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
20392

Handwritten signature

Fer Tel: [+960] 333 5949 [+960] 333 5951
Po Fax: [+960] 333 5953

Email: secretariat@epa.gov.mv
Website: www.epa.gov.mv

5 of 6

Male', Republic of Maldives
Tel: [960] 300 7555
Fax: [960] 332 7555

2020/01
Email: info@fenaka.com.mv
Website: www.fenaka.com.mv



ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ - ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
"Dhivehin" – Always Maldivian, Forever Independent



ދިވެހިސަރުކާރުގެ ގެޒެޓް
Environmental Protection Agency
EPA

Task 8. Stakeholder consultation, Inter-Agency coordination and public/NGO participation) – Identify appropriate mechanisms for providing information on the development proposal and its progress to all stakeholders, government authorities, government agencies, NGOs, engineers/designers, development managers, staff and members of the general public. The EIA report should include a list of people/groups consulted, their contact details and summary of the major outcomes. If any forms are used for public consultation, it shall be approved by the relevant government authorities and annexed.

Presentation- The environmental impact assessment report, to be presented in digital format, will be concise and focus on significant environmental issues. It will contain the findings, conclusions and recommended actions supported by summaries of the data collected and citations for any references used in interpreting those data. The environmental assessment report will be organized according to, but not necessarily limited by, the outline given in the Environmental Impact Assessment Regulations 2012.

Timeframe for submitting the EIA report – The developer must submit the completed EIA report within 6 months from the date of this Term of Reference.



17th March 2016



ECA003

Environmental Protection Agency
Green Building, 3rd Floor, Handhuvaree/Hingun
Male', Rep. of Maldives, 20392

ދިވެހިސަރުކާރުގެ ގެޒެޓް
ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
20392

Fel: Tel: [+960] 333 5949 : ޖެލްފޯން : [+960] 333 5951
Po: Fax: [+960] 333 5953 : ފެކްސް

Email: secretariat@epa.gov.mv : ީމެއިލް
Website: www.epa.gov.mv : ވެބްސައިޓް

6 of 6

Male', Republic of Maldives
Tel: [960] 300 7555 : ޖެލްފޯން
Fax: [960] 332 7555 : ފެކްސް

ދިވެހިރާއްޖޭގެ ޖުމްހޫރިއްޔާ
Email: info@fenaka.com.mv : ީމެއިލް
Website: www.fenaka.com.mv : ވެބްސައިޓް

Water sample results from MWSC

Male' Water & Sewerage Company Pvt Ltd
Water Quality Assurance Laboratory
 FEN Building 5th Floor, Machhangolhi, Ameeremmagu, Male', Maldives
 Tel: +9603323209, Fax: +9603324306, Email: wqa@mwsc.com.mv

ދިވެހިސަރުކާރުގެ ގެޒެޓް



Customer Informations :

Fenaka Corporation Limited
 Port Complex Building,
 Hilaalee Magu,
 Male',
 Rep of Maldives



WATER QUALITY TEST REPORT

Test Report No: 300777/2016/22

Date: 07/04/2016

Sample Description / Location	G. Dh Madelia			TEST METHOD	UNIT
	Naatakuge	Coral Garden	Proposed powerhouse		
Sample Type	Ground water			TEST METHOD	UNIT
Sample Date	4/4/2016				
Sample Received Date	5/4/2016				
Test Requisition Form No.	900163134				
Sample No.	822504	822505	822506		
Date of Analysis	5/4/2016-6/4/2016				
PARAMETER					
Physical Appearance	Clear with particles	Clear with particles	Clear with particles	Visual	
Conductivity	1294	487	1493	Method 2510 B. (Adapted from Standard methods for the examination of water and waste water, 22nd edition)	µS/cm
pH	7.40	8.25	7.33	Method 4500-H+ B. (Adapted from Standard methods for the examination of water and waste water, 21st edition)	-
Salinity	0.65	0.24	0.75	Method 2520 B. (Adapted from Standard methods for the examination of water and waste water, 22nd edition)	‰
Temperature	22.6	22.7	22.7	Electrometry	°C
Total Petroleum Hydrocarbon (TPH)	0.06	0.09	0.06	UV Fluorescence	mg/L
Turbidity	0.270	0.311	1.69	HACH Nephelometric Method (Adapted from HACH 2100N Turbidimeter User Manual)	NTU


Keys:
 µS/cm: Micro Siemens per centimeter, %: Parts Per Thousand, mg/L: Milligram Per Liter, °C: Degree Celsius, NTU: Nephelometric Turbidity Unit
 Loc: Limit of Quantification


Checked by:  Afnan Farooq Laboratory Executive	Approved by:  Mohamed Eyma Senior Technical Officer
--	---

Notes:
Sampling Authority: Sampling was not done by MWSC Laboratory
 This report shall not be reproduced except in full, without written approval of MWSC
 This test report is ONLY FOR THE SAMPLES TESTED.
 ~ Information Supplied by the customer

*****END OF THE REPORT*****

EIA report receipt receipt from G.Dh Atoll Council

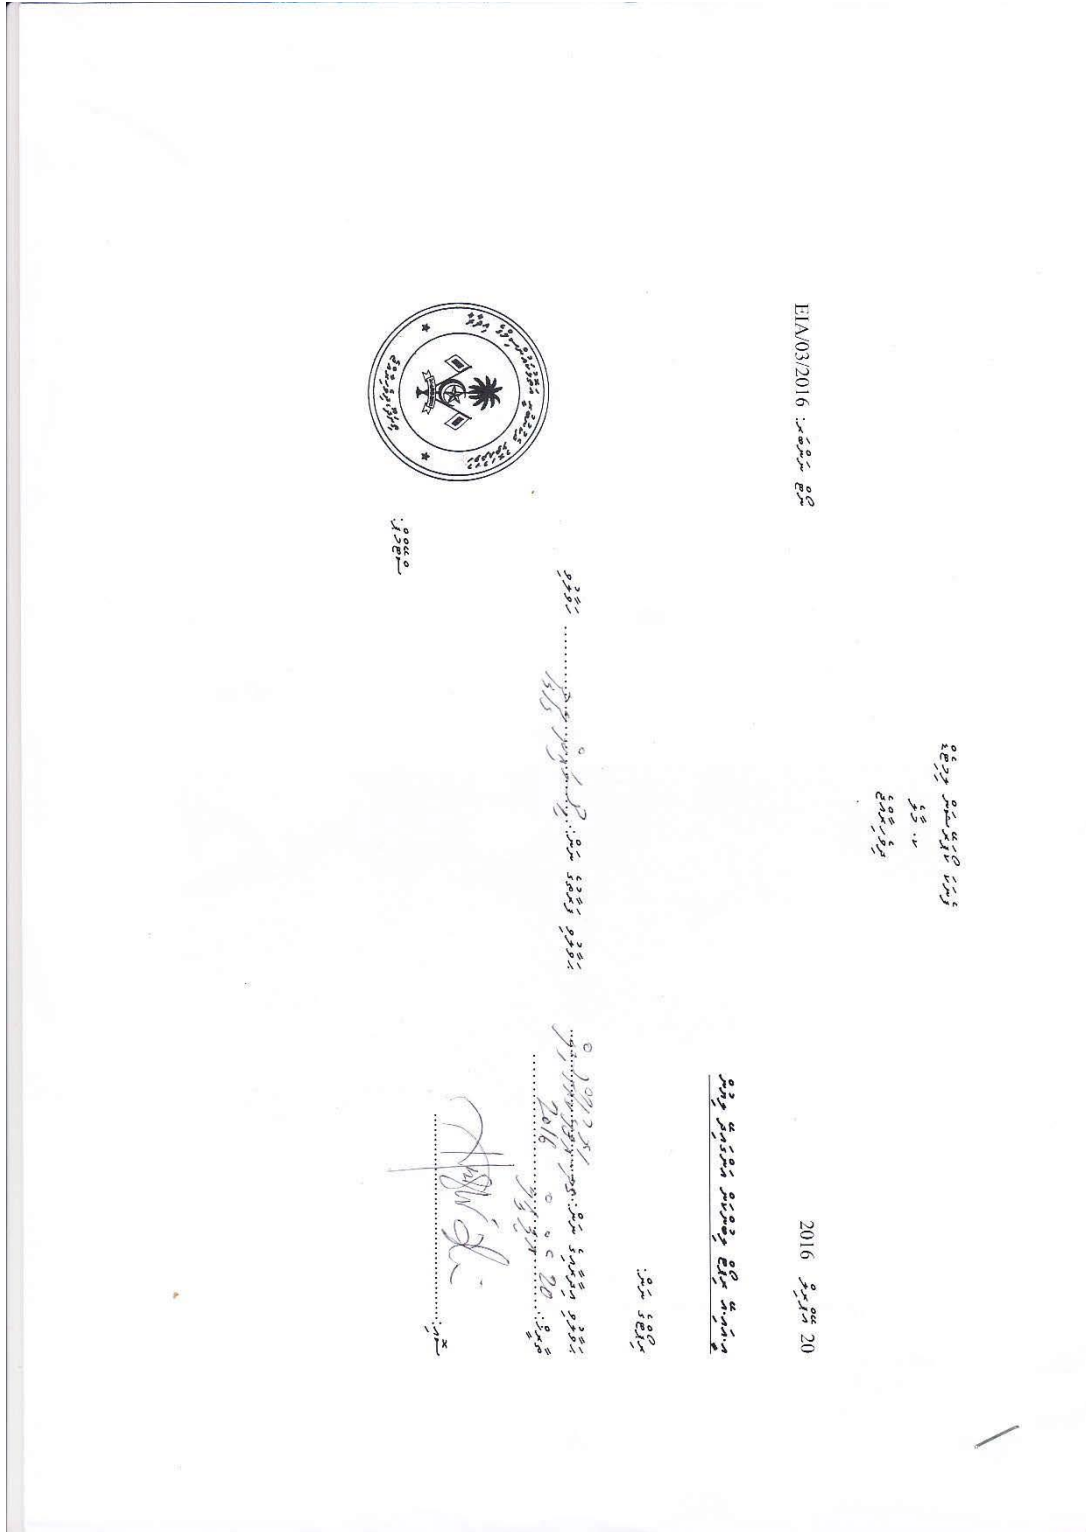

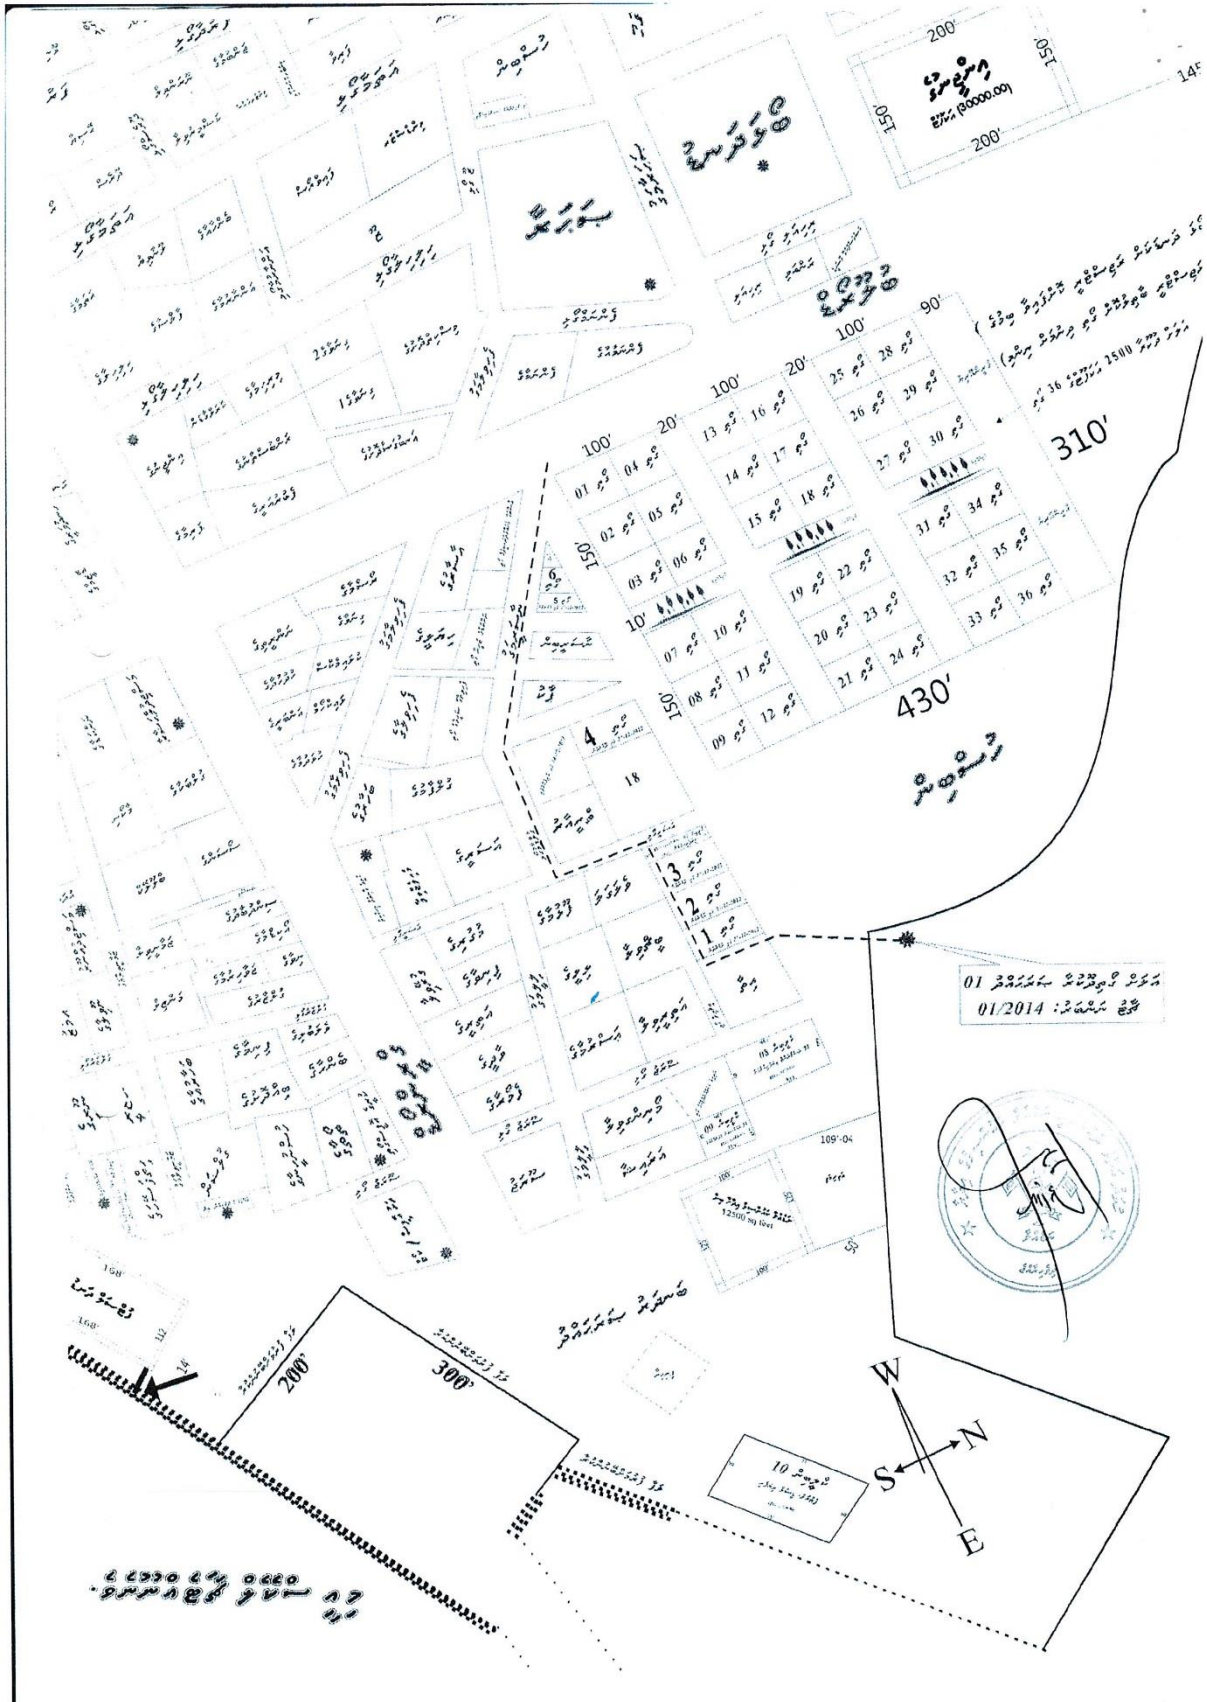

پلاٹ نمبر 01 کی تفصیلات
01/2014



Fer
Po
Mc
Tel:
Fax:

[960] 300 7555
[960] 332 7555

فون نمبر:
فیکس نمبر:

Email: info@fenaka.com.mv
Website: www.fenaka.com.mv

پلاٹ نمبر:
پلاٹ نمبر:

Environmental Impact Assessment Team

The EIA was carried out by a team led by Ali Shareef (ETA 19/11). Supporting members of the team include Mahfooz Abdull Wahhab (Registration no: EIA TA03/15) and Mohamed Ibrahim.

CURRICULUM VITAE OF MAHFOOZ ABDULL WAHHAH

PERSONAL DETAILS

Name: Mahfooz Abdull Wahhab
Nationality: Maldivian
Gender: Male
Date of Birth: 10th December 1992

Present address for communication: No Chance
K. Villingili
Malé
Republic of Maldives
Tel: (960) 9994467 (M)
Email: mahfoozabdullwahhab@gmail.com

EDUCATIONAL QUALIFICATION

SECONDARY EDUCATION:

High School Diploma

2008-2010 Centre for Higher Secondary Education, Male', Maldives

GCE O' level

2005-2007 Dharumavantha School, Malé, Republic of Maldives

TERTIARY EDUCATION:

Bachelor of Environmental Management

2012-2014 Maldives National University, Male', Maldives

OTHER QUALIFICATIONS

- PADI Advance Open water Diver
- Certificate II in Information Technology
- Registered EIA consultant

PROFESSIONAL EXPERIENCE

EIA for the coastal modification and protection measures of B. Voavah, January 2016. The project was to determine the environmental impacts arising from the coastal modification and protection works around B. Voavah. I was involved in the survey and the formulation of the EIA report to assess the environmental impacts arising from the project.

Survey of sewer system in H.Dh Nolvivaranfaru, December 2015. The survey was to determine the condition of the sewer system in Nolvivaranfaru. I was involved in the inspection of the manholes, pump stations and sea outfall.

EIA for the partial renovation and upgrade works of Six senses Laamu, L. Olhuveli, October 2015. The project was to determine the environmental impacts arising from the renovation works at Six senses Laamu jetties and Villas. I was involved in the survey and the formulation of the EIA report to assess the environmental impacts arising from the project.

EIA for the partial renovation and upgrade works of Four Seasons Kuda Huraa, August 2015. The project was to determine the environmental impacts arising from the renovation works at Kuda Huraa water villas and walkway jetties. I was involved in the survey and the formulation of the EIA report to assess the environmental impacts arising from the project.

EIA for the relocation of Trees from B.Kihaadhoo to B.Voavah, August 2015. The project was to relocate 50 trees from B.Kihaadhoo housing plots to B.Voavah which is going to be developed as a Luxury Tourist Resort. I was involved in the survey and the formulation of the EIA report to assess the environmental impacts arising from the project.

EIA for the development of B.Voavah as a Luxury Tourist resort, July 2015. The project was to determine the environmental Impact arising from the development of B.Voavah as a tourist. I was involved in the survey and the formulation of the EIA report to assess the environmental impacts arising from the project.

EIA for Coral Frame Project at Maalifushi, Thaa Atoll, May 2015. The project aims to rehabilitate the coral reef of Maalifushi by deploying coral frames around the reef. I was involved in the survey and the formulation of the EIA report to assess the environmental impacts arising from the project.

Coral Frame Project at Kanifushi, Kaafu Atoll. Monitoring of the coral frames in April 2015 under the project.

Coral Frame Project at Kuda Huraa, Kaafu Atoll. Monitoring of the coral frames in March 2015 under the project.

EIA for Coral Frame Project at Kanuhuraa, Lhaviyani Atoll, October 2014. The project aims to rehabilitate the coral reef of Kanuhuraa by deploying coral frames around the reef. I was involved in the survey and the formulation of the EIA report to assess the environmental impacts arising from the project.

Coral Frame Project at Kanuhuraa, Lhaviyani Atoll. I was involved in the launching of the project in August 2014. This involved transplantation of corals to the frames and its consecutive deployment in Kanuhuraa reef. In addition, the initial monitoring of the frames after transplantation.

Coral Frame Project at Landaa Giraavaru, Baa Atoll. Monitoring of the coral frames in August 2014 under the project.

CURRICULUM VITAE OF MOHAMED IBRAHIM JALEEL

Curriculum Vitae of MOHAMED IBRAHIM JALEEL

1.	NAME	:	Mohamed Ibrahim Jaleel												
2.	DATE OF BIRTH	:	9 May 1991												
3.	CITIZENSHIP	:	Maldivian												
4.	PERSONAL ADDRESS	:	V.Edhuruvehi Male'												
5.	TELEPHONE NO.	:	(960)9768999												
	E-MAIL ADDRESS	:	Mohamed.ibrahimjaleel@hotmail.com												
	EDUCATION	:	General Certification of Education, (GCE) Ordinary Level. In 2007 (Science stream)												
			General Certification of Education (Edexcel), in Advance Level. In 2010 (Science stream)												
			Certificate in Project Management from Clique colleague												
			Bachelor's Degree on Environmental Management from the Maldives National University.												
			Post Graduate Diploma in Research Studies												
6.	OTHER TRAINING	:	Graphics designing short course from IBI												
			Took part in lecture series held by IUCN Maldives on various conservation issues and opportunities in the Maldives												
			Training on preparation of EMMP under the MGCC project of USAID												
			Training workshop on IWRRM concepts under the GEF project, Kenya, Nivasha												
			Took part in the development of the Maldives National Strategic Action Plan as focal point from Water and Sewer sector												
7.	LANGUAGE & DEGREE OF PROFICIENCY	:	<table border="0" style="width: 100%;"> <tr> <td></td> <td style="text-align: center;"><u>Speaking</u></td> <td style="text-align: center;"><u>Writing</u></td> <td style="text-align: center;"><u>Reading</u></td> </tr> <tr> <td>English</td> <td style="text-align: center;">Excellent</td> <td style="text-align: center;">Excellent</td> <td style="text-align: center;">Excellent</td> </tr> <tr> <td>Dhivehi</td> <td style="text-align: center;">Mother tongue</td> <td style="text-align: center;">Mother tongue</td> <td style="text-align: center;">Mother tongue</td> </tr> </table>		<u>Speaking</u>	<u>Writing</u>	<u>Reading</u>	English	Excellent	Excellent	Excellent	Dhivehi	Mother tongue	Mother tongue	Mother tongue
	<u>Speaking</u>	<u>Writing</u>	<u>Reading</u>												
English	Excellent	Excellent	Excellent												
Dhivehi	Mother tongue	Mother tongue	Mother tongue												
8.	MEMBERSHIP IN CIVIC AND PROFESSIONAL SOCIETIES	:													
9.	Referees	:	<ul style="list-style-type: none"> • Hussain Hameez – Director, Fenaka Corporation. • Ahmed Zahid – Managing Director of Sandcays Pvt. Ltd. (7781535) • Aishath Ali – Registrar of the Maldives National University (7788167) • Shaheeda Adam Ibrahim – Director General of Water and Sanitation department, MEE. (3018381) 												

MOHAMED IBRAHIM JALEEL

10. EMPLOYMENT RECORD :

FROM: Jan 2016
EMPLOYER
POSITION HELD AND
DESCRIPTION OF DUTIES

TO: Present
Classy pool Pvt, Ltd
Environmental Engineer.

- Overseeing all the EIA related projects of the company

FROM: May 2015
EMPLOYER
POSITION HELD AND
DESCRIPTION OF DUTIES

TO: Present
Fenaka Corporation, Utilities Services Division
Assistant Director.

- Overseeing all the water and sanitation related projects under the company
- Overseeing all the water and sewer systems operated under the company.

FROM: Jan 2015
EMPLOYER
POSITION HELD AND
DESCRIPTION OF DUTIES

TO: May 2015
Ministry of Environment and Energy, Water and Sanitation Department
Assistant Director.

- Overseeing all the donor related water and sewerage projects.
- Manage and supervise the implementation of project work on a daily basis.
- Administrative and Policy related works of the sector.

FROM: Feb 2014
EMPLOYER
POSITION HELD AND
DESCRIPTION OF DUTIES

TO: January 2015
Sandcays Pvt. Ltd.
Research assistant. Assisting in environmental research, environmental surveys and monitoring, drafting of EIA/ESIA reports and other documentation.

FROM: 2011
EMPLOYER
POSITION HELD AND
DESCRIPTION OF DUTIES

TO: 2011
Ministry of Health and Gender
Child care supervisor (full time). Monitoring and reporting the actions of the child care officers and the needs of the children in Kudakudhinge hiyaa. Carrying out and planning various activities that are necessary for the growth and development of the children. Formulating the annual and the monthly schedule for the children and the child care workers. Attending to emergencies and accidents that occur within the kudakudhinge hiya sector.

FROM: 2011
EMPLOYER
POSITION HELD AND
DESCRIPTION OF DUTIES

TO: 2012
Maldives National University
Admission and Registration officer. Carrying out the respective works of the admission and registration section of the Maldives National University.

MOHAMED IBRAHIM JALEEL

12. RELEVANT WORK EXPERIENCE

Project Name : Study and EIA for proposed Reclamation and Resort Development on K. Tholhimarahura
 Client : J Lagoons pvt. Ltd.
 Period : Sep 2014 Time Spent: 4 week
 Position Held : Research assistant
 Duties : Assisted in drafting/compiling of report

Project Name : Study and EIA for proposed STP for Alimatha Aquatic Resort, Vaavu Atoll
 Client : Alimatha Aquatic Resort
 Period : Aug 2014 Time Spent: 3 week
 Position Held : Research assistant
 Duties : Assisted in drafting/compiling of report

Project Name : Survey and EIA for proposed STP for Mayaafushi Island Resort, Alif Alif Atoll
 Client : Mayaafushi Island Resort
 Period : Aug 2014 Time Spent: 3 week
 Position Held : Research assistant
 Duties : Assisted in drafting/compiling of report

Project Name : Study and EIA for proposed STP for Diggiri Tourist Resort, Vaavu Atoll
 Client : Dhiggiri Tourist Resort
 Period : Aug 2014 Time Spent: 3 week
 Position Held : Research assistant
 Duties : Assisted in surveying activities and drafting/compiling of report.

Project Name : Survey of Ensis RO plant Registration, Hulhumale'
 Client : Ensis Pvt. Ltd.
 Period : Aug 2014 Time Spent: 2 days
 Position Held : Research assistant
 Duties : Assisted in surveying activities

Project Name : Study and EIA for proposed Resort development project in Kanbaalifaru, Shaviyani Atoll
 Client : Kanbaalifaru Investments Pvt. Ltd.
 Period : June 2014 Time Spent: 4 weeks
 Position Held : Research assistant
 Duties : Assist in the drafting/compiling of the EIA report based on previous work

Project Name : Study and EIA for the proposed Water Supply system in HA. Thuraakunu
 Client : Upper North Province Council
 Period : June 2014 Time Spent: 3 weeks
 Position Held : Research assistant
 Duties : Assist in the drafting/compiling of the EIA report based on previous work

Project Name : Study and EIA for the Aa.Thoddoo water supply project
 Client : MWSC
 Period : May 2014 Time Spent: 1 week
 Position Held : Research assistant
 Duties : Responsible for the survey equipment, assisted in all surveying activities

Project Name : As built Survey of B. Kihaadhufaru Resort
 Client : lbsun pvt.ltd
 Period : May 2014 Time Spent: 1 week
 Position Held : Research assistant
 Duties : Responsible for the survey equipment, assisted in all surveying activities

Project Name : Survey of H.Marvel EIA
 Client : Adam Saleem
 Period : May 2014 Time Spent: 1 day
 Position Held : Research assistant
 Duties : Assisted in survey of the EIA report based on previous work

Project Name : Study and EIA for proposed Coastal protection of Paradise Island Resort, North Male' Atoll
 Client : Diza Travels and Trade Pvt.Ltd
 Period : April 2014 Time Spent: 4 weeks
 Position Held : Research assistant
 Duties : Assist in the drafting/compiling of the EIA report based on previous work

Project Name : Study and EIA for proposed Resort development project in Maareha, Gaaf Alif Atoll
 Client : Moving International Pvt.Ltd
 Period : April 2014 Time Spent: 4 weeks

March 2016

Page (3)

MOHAMED IBRAHIM JALEEL

Position Held	: Research assistant	
Duties	: Assist in the drafting/compiling of the EIA report based on previous work	
Project Name	: ESIA for five schools under Enhancing Education Development Project	
Client	: Ministry of Education	
Period	: February 2014	Time Spent: 4 weeks
Position Held	: Research assistant	
Duties	: Assist in compiling socio-economic profiles of islands and review of ESIA report	
Project Name	: EIA for proposed harbour rehabilitation in Holudhoo, Noonu Atoll	
Client	: Maldives Transport and Contacting Company (MTCC)	
Period	: March 2014	Time Spent: 4 weeks
Position Held	: Research assistant	
Duties	: Assist in the drafting/compiling of the EIA report based on previous work	
Project Name	: EIA for proposed harbour Construction in Dhangethi, Alif Dhaal Atoll	
Client	: Maldives Transport and Contacting Company (MTCC)	
Period	: March 2014	Time Spent: 2 weeks
Position Held	: Research assistant	
Duties	: Assist in drafting/compiling the EIA report	
Project Name	: EIA for proposed Airport Development at Dh.Kudahuvadho	
Client	: Reollo Investments	
Period	: March 2014	Time Spent: 4 weeks
Position Held	: Research assistant	
Duties	: Assist in drafting/compiling the EIA report. Carried out monitoring surveys in the implementation phase.	

MOHAMED IBRAHIM JALEEL

Project Name	: Survey for L. Maamendhoo Sewerage project
Client	: Fenaka
Period	: Time Spent: 1 weeks
Position Held	: Research assistant
Duties	: Carried out the survey for the initial concept design of the project, which included taking the block level survey of as built and the levels (elevation) survey for the island.
Project Name	: OFID (Phase 1) Provision of Water Supply Facilities 04(Four) Island and Sewerage Facilities in 05 (Five) Island, Maldives
Client	: OFID
Period	: Time Spent: 2 weeks
Position Held	: Research assistant
Duties	: Team leader responsible for overseeing all the project activities and issues
Project Name	: EMP for the proposed project to update the STP in Dhiggiri Resort
Client	: Aqua Solutions
Period	: Time Spent: 2 weeks
Position Held	: Research assistant
Duties	: Assist in drafting/compiling the EIA report. Carried out monitoring surveys in the implementation phase.
Project Name	: Survey and EMP for the proposed project to update the STP in Mayaafushi Resort
Client	: Aqua Solutions
Period	: Time Spent: 2 weeks
Position Held	: Research assistant
Duties	: Assist in drafting/compiling the EIA report. Carried out monitoring surveys in the implementation phase.
Project Name	: Survey and EIA for the proposed Phase (2) of Niyaama Resort
Client	: Niyaama Resort
Period	: Time Spent: 4 weeks
Position Held	: Research assistant
Duties	: Was involved in the survey activities and carried out all the respective works of drafting/compiling the EIA report.
Project Name	: OFID Loan phase 2 – Water Supply and Sewerage Project (04 Island Sewerage, 10 Island Water Supply Facilities and 29 Island RO Installation and Storage Enhancement)
Client	: OFID
Period	: Time Spent: To April 2015
Position Held	: Assistant Director
Duties	: Managing the project as team leader, preparation and review of bids and proposals, evaluation reports and drafting of contract documents.
Project Name	: IDB – Sanitation in Five Island Project
Client	: IDB
Period	: Time Spent: To May 2015
Position Held	: Assistant Director
Duties	: Managing the project as team leader, preparation and review of bids and proposals, evaluation reports and drafting of contract documents.
Project Name	: Water supply project (UNOPS) in Lh. Hinnavaru with the inclusion of awareness component (CHEMONICS)
Client	: USAID
Period	: Time Spent: To May 2015
Position Held	: Assistant Director
Duties	: Team leader responsible for overseeing all the project activities and issues
Project Name	: KUWAIT FUND water supply project in Gn.Fuvahmulah
Client	: KUWAIT FUND
Period	: Time Spent: To May 2015
Position Held	: Assistant Director
Duties	: Managing the project as team leader, preparation and review of bids and proposals, evaluation reports and drafting of contract documents.
Project Name	: National water awareness campaign
Client	: MEE
Period	: Time Spent: To May 2015
Position Held	: Assistant Director
Duties	: Team leader responsible for overseeing all the programme activities and resolve any setbacks.

MOHAMED IBRAHIM JALEEL

Project Name	: Establishment of water supply services in all the islands of Addu city
Client	: MEE
Period	: Time Spent: To present
Position Held	: Assistant Director
Duties	: Responsible for overseeing all the project activities and issues
Project Name	: Design and Built of Sewer Systems in the islands of Th.Buruni, Th.Madifushi
Client	: MEE
Period	: Time Spent: To present
Position Held	: Assistant Director
Duties	: Responsible for overseeing all the project activities and issues
Project Name	: Design and Built of Sewer Systems in the islands of L.Maamendhoo
Client	: MEE
Period	: Time Spent: To present
Position Held	: Assistant Director
Duties	: Responsible for overseeing all the project activities and issues
Project Name	: Provision of Sewer service to – housing units in L.Fonadhoo
Client	: MEE
Period	: Time Spent: To present
Position Held	: Assistant Director
Duties	: Responsible for overseeing all the project activities and issues
Project Name	: Provision of Sewer service in Addu city, Hithadhoo, central area
Client	: MEE
Period	: Time Spent: To present
Position Held	: Assistant Director
Duties	: Responsible for overseeing all the project activities and issues

13. CERTIFICATION:

I, THE UNDERSIGNED, confirm that to the best of my knowledge, this CV correctly describes me, my qualifications and my experience

Mohamed Ibrahim Jaleel